

REGUPOL AMERICA

ACOUSTICAL

PERFORMANCE

TEST REPORT

SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON ENGINEERED WOOD WITH REGUPOL
SONUSWAVE UNDERLAYMENT - AMERIFORM NOCOM STRUCTURAL MAGNESIUM
BOARD

SPECIMEN TYPE

254 mm Steel C-Joist Assembly with Regupol® SonusClip™ Sound Isolation Clip

REPORT NUMBER

J8051.10-113-11-R0

TEST DATE

06/24/19

ISSUE DATE

09/11/19

RECORD RETENTION END


06/24/23

PAGES

12

DOCUMENT CONTROL

ATI 00629 (03/21/18)
RTTDS-R-AMER-Test-2844
© 2017 INTERTEK

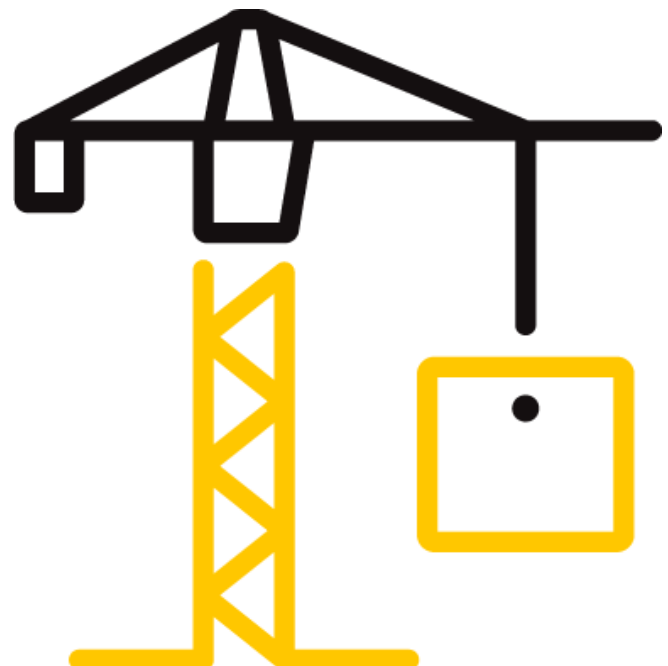

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

REPORT ISSUED TO

REGUPOL AMERICA

11 Ritter Way

Lebanon, Pennsylvania 17042

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted to perform testing in accordance with ASTM E90 AND ASTM E492 on Engineered Wood with Regupol SonusWave Underlayment - Ameriform NOCOM Structural Magnesium Board. This report is a reissue in the name of Regupol America through written authorization from the original report holder. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2

SUMMARY OF TEST RESULTS

DATA FILE NO.	J8051.05
SERIES/MODEL:	Engineered Wood with Regupol SonusWave Underlayment - Ameriform NOCOM Structural Magnesium Board
STC	57
IIC	54

COMPLETED BY: David M. Dacheux III
Technician - Acoustical
TITLE: Testing
SIGNATURE:
DATE: 09/11/19

COMPLETED BY: Jordan Strybos
Engineer, Team Lead -
TITLE: Acoustical Testing
SIGNATURE:
DATE: 09/11/19

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.



TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 3**TEST METHODS**

The specimen was evaluated in accordance with the following:

ASTM E90-09 (2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*

ASTM E413-16, *Classification for Rating Sound Insulation*

ASTM E492-09(2016)e1, *Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine*

ASTM E989-18, *Classification for Determination of Impact Insulation Class (IIC)*

ASTM E2235-04 (2012), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

SECTION 4**MATERIAL SOURCE/INSTALLATION**

The full test specimen was assembled on the day of testing by B&C. All materials provided by the original client were installed on an existing B&C assembly (254 mm Steel C-Joist Assembly with Regupol® SonusClip™ Sound Isolation Clip) utilizing B&C-supplied materials. The assembly was installed in a steel test frame which was installed into the opening between the source and receive rooms in the test chamber. The test frame was isolated from the structure with dense neoprene gasket.

The total weight of the floor/ceiling assembly was 568.1 kg. B&C will store samples of the test specimen for four years. Photographs of the test specimen are included in the report. The client did not supply drawings of the test specimen.

This report is reissued in the name of Regupol America through written authorization from the original report holder. The original Report No. is J8051.05-113-11.

B&C will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by B&C for the entire test record retention period.

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

**SECTION 5
EQUIPMENT**

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	INT00977	08/18 *
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	65124	05/18 *
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	63763-1	06/18 *
Microphone Calibrator	Larson Davis	CAL200	Acoustical Calibrator	INT00852	09/18
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63741	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63739	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	67340	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63746	09/18
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63747	07/18
Receive Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63810	10/18
				63811	10/18
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65029	03/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65586	02/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT01089	01/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00652	01/19
Source Room Microphone	PCB Electronics	378C20	Microphone and Preamplifier	63742	03/19
Source Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63812	10/18
Tapping Machine	Norsonic	Nor277	Tapping Machine	INT00936	12/18

* The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

VT RECEIVE ROOM VOLUME	156.8 m ³
VT SOURCE ROOM VOLUME	190 m ³

**SECTION 6
LIST OF OFFICIAL OBSERVERS**

NAME	COMPANY
Michael K. Daniel	Intertek B&C
Jordan Strybos	Intertek B&C

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 7**TEST PROCEDURE**

The microphones were calibrated before conducting the tests. The air temperature and relative humidity conditions were monitored and recorded during all measurements. The average temperature and humidity of both the source and received rooms are listed in Sections 10 and 11. The maximum and minimum temperatures and humidities of the receive room from the duration of the test are listed in Sections 12 and 13.

The airborne transmission loss test was conducted in accordance with the ASTM E90 test method using the single direction method. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Two sound pressure level measurements were made simultaneously in both rooms, at each of five microphone positions.

The impact sound transmission test was conducted in accordance with the ASTM E492 test method. Two background noise sound pressure level, two sound pressure level measurements with the tapping machine operating at each position specified by ASTM E492, and five sound absorption measurements were conducted at each of five microphone positions.

Detailed test procedures, data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

SECTION 8**TEST CALCULATIONS**

The STC (Sound Transmission Class) and IIC (Impact Insulation Class) ratings were calculated in accordance with ASTM E413 and ASTM E989, respectively.

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 9

TEST SPECIMEN DESCRIPTION

MATERIAL	DIMENSIONS (mm)	THICKNESS (mm)	MANUFACTURER AND SERIES	QUANTITY	AVERAGE WEIGHT
Engineered Hardwood	Varied by 125	9.1	Shaw Danner 3-1/4	10.98 m ²	7.67 kg/m ²
	Note: Loose laid				
Sound Control Underlayment	3023 by 1219	6.0	Regupol® SonusWave™	10.98 m ²	3.56 kg/m ²
	Note: Loose laid				
Structural Magnesium Board	1219 by 2438	19.2	Ameriform NOCOM	10.98 m ²	19.82 kg/m ²
	Note: Fastened to the floor joists with 41 mm #8 screws spaced on 152.4 mm centers along the perimeter and on 406.4 mm centers in the field				
Fiberglass Insulation	2940 by 406	88.9	Knauf EcoBatt®	10.98 m ²	1.03 kg/m ²
	Note: Laid directly over resilient channels				
Steel C-Joist	3023 by 41.3	254.0	ClarkDietrich S162	6 joists	11.6 kg/joist
	Note: Installed on 610 mm centers using JUS414 hanger brackets				
Resilient Sound Isolation Clip	76.2 by 36.5	31.8	Regupol® SonusClip™	24 clips	0.06 kg/clip
	Note: Installed in a 610 mm by 1219 mm grid pattern				
Furring/Hat Channel	3658 by 76.2	22.3	ClarkDietrich 087F125-18	29.1 lin m	0.48 kg/m
	Note: Installed into the isolation clips, spaced 610 mm on center				
Gypsum Panel	1219 by 3023	15.9	USG SHEETROCK® Brand FIRECODE® C Core	10.98 m ²	11.91 kg/m ²
	Note: Fastened to the channels on 305 mm centers with 25.4 mm Type S bugle head screws. The seams of the gypsum panels were sealed with Pecora AC-20 FTR caulk and covered with pressure sensitive tape.				

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 10

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS



TEST DATE	6/24/2019				
DATA FILE NO.	J8051.05				
CLIENT	Regupol America				
DESCRIPTION	9.1 mm Shaw Danner 3-1/4 Engineered Hardwood, 6 mm Regupol® SonusWave™ Sound Control Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	22.1°C	Source Temp.	22.9°C
TECHNICIAN	MKD	Receive Humidity	59%	Source Humidity	59%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
80	38.0	18.1	109	67	41	2.7	-
100	30.9	12.0	106	69	38	2.6	-
125	32.2	10.9	104	63	42	1.5	0
160	34.9	9.7	104	65	42	1.6	2
200	26.5	10.3	102	58	46	1.7	1
250	22.7	10.1	100	54	47	1.0	3
315	22.5	9.4	104	55	50	0.9	3
400	18.8	8.1	101	55	48	0.6	8
500	19.3	7.9	101	53	50	0.5	7
630	22.0	7.4	103	50	55	0.5	3
800	20.7	7.6	102	45	59	0.6	0
1000	20.0	7.5	102	44	60	0.4	0
1250	18.8	7.4	102	42	62	0.5	0
1600	13.2	7.8	102	40	64	0.5	0
2000	12.4	8.5	102	38	66	0.3	0
2500	9.6	9.5	100	35	67	0.4	0
3150	8.5	10.2	101	32	70	0.4	0
4000	7.1	11.5	102	30	73	0.4	0
5000	6.2	13.1	102	27	75	0.7	-
6300	6.3	16.1	96	17	78	0.8	-
8000	6.7	21.0	96	12	81	1.1	-
10000	6.9	21.0	90	7	81	0.9	-
STC Rating	57	<i>(Sound Transmission Class)</i>			Sum of Deficiencies	27	

- Notes:**
- 1) Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.
 - 2) Specimen TL levels listed in red are potentially limited by the laboratory flanking limit.
 - 3) Specimen TL levels listed in blue indicate the lower limit of the transmission loss.
 - 4) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0


Date: 09/11/19

SECTION 11

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS GRAPH



TEST DATE	6/24/2019				
DATA FILE NO.	J8051.05				
CLIENT	Regupol America				
DESCRIPTION	9.1 mm Shaw Danner 3-1/4 Engineered Hardwood, 6 mm Regupol® SonusWave™ Sound Control Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	22.1°C	Source Temp.	22.9°C
TECHNICIAN	MKD	Receive Humidity	59%	Source Humidity	59%

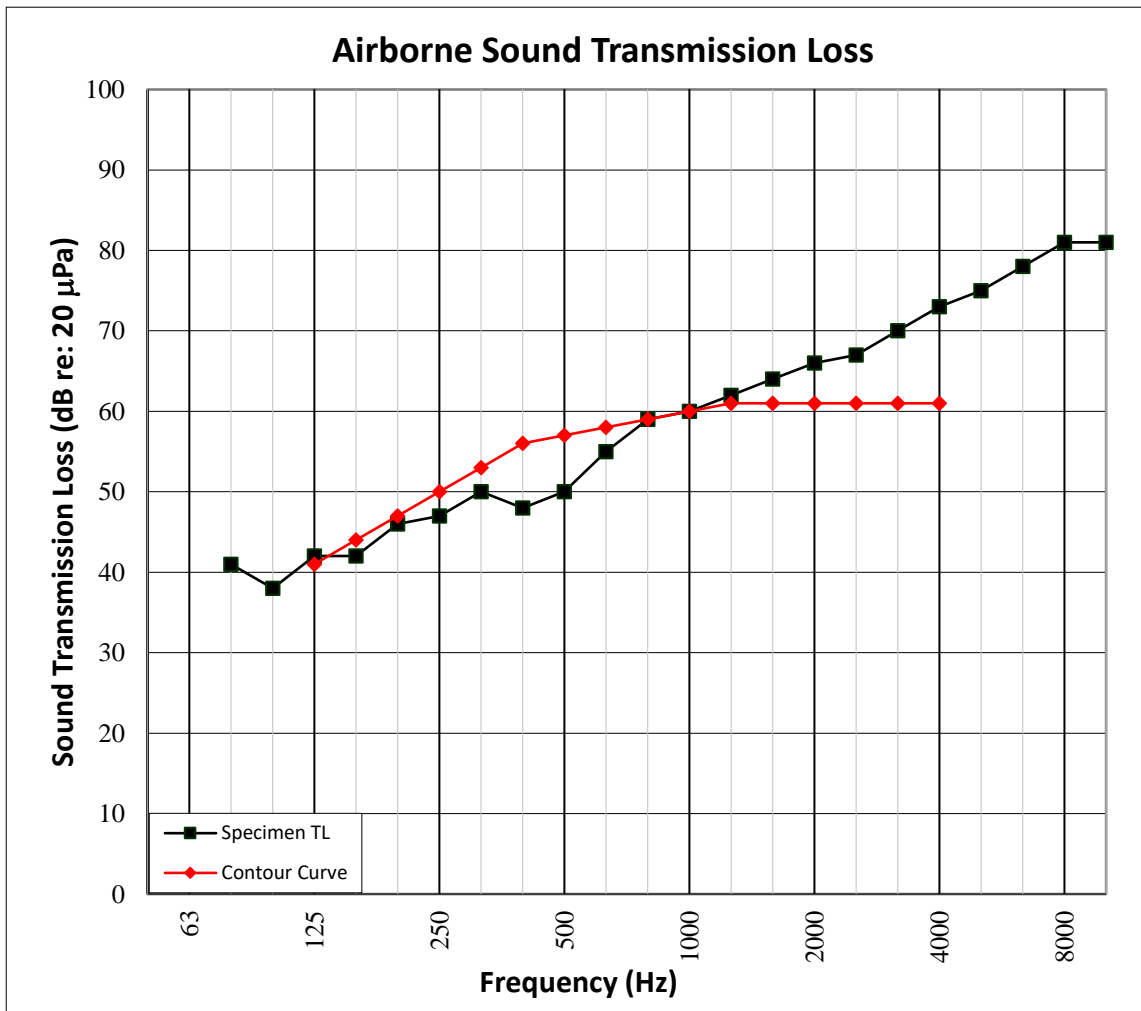

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 12

TEST RESULTS - IMPACT SOUND TRANSMISSION



TEST DATE	6/24/2019				
DATA FILE NO.	J8051.05				
CLIENT	Regupol America				
DESCRIPTION	9.1 mm Shaw Danner 3-1/4 Engineered Hardwood, 6 mm Regupol® SonusWave™ Sound Control Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	22.1°C	Minimum Temp.	22.1°C
TECHNICIAN	MKD	Max. Humidity	60%	Min. Humidity	59%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	NORMALIZED IMPACT SPL (dB)	95% CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
80	37.9	16.9	66	1.9	-
100	31.2	11.6	66	1.7	8
125	31.3	11.6	64	1.4	6
160	34.8	10.0	61	1.0	3
200	26.6	10.2	61	0.4	3
250	23.8	10.7	60	1.0	2
315	23.4	9.9	56	0.4	0
400	19.1	8.2	55	0.5	0
500	19.8	7.6	50	0.4	0
630	21.2	7.4	48	0.2	0
800	20.7	7.5	44	0.2	0
1000	19.9	7.6	40	0.2	0
1250	20.0	7.5	37	0.2	0
1600	13.1	7.9	33	0.2	0
2000	12.3	8.4	29	0.1	0
2500	9.5	9.5	23	0.3	0
3150	8.1	10.2	18	0.4	0
4000	6.9	11.7	14	0.5	-
5000	6.2	13.1	10	0.3	-
6300	6.3	16.1	8	0.2	-
8000	6.6	21.1	9	0.2	-
10000	7.0	21.1	9	0.3	-
IIC Rating	54	<i>(Impact Insulation Class)</i>		Sum of Deficiencies	22

Notes: Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0


Date: 09/11/19

SECTION 13

TEST RESULTS - IMPACT SOUND TRANSMISSION GRAPH



TEST DATE	6/24/2019				
DATA FILE NO.	J8051.05				
CLIENT	Regupol America				
DESCRIPTION	9.1 mm Shaw Danner 3-1/4 Engineered Hardwood, 6 mm Regupol® SonusWave™ Sound Control Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	22.1°C	Minimum Temp.	22.1°C
TECHNICIAN	MKD	Max. Humidity	60%	Min. Humidity	59%

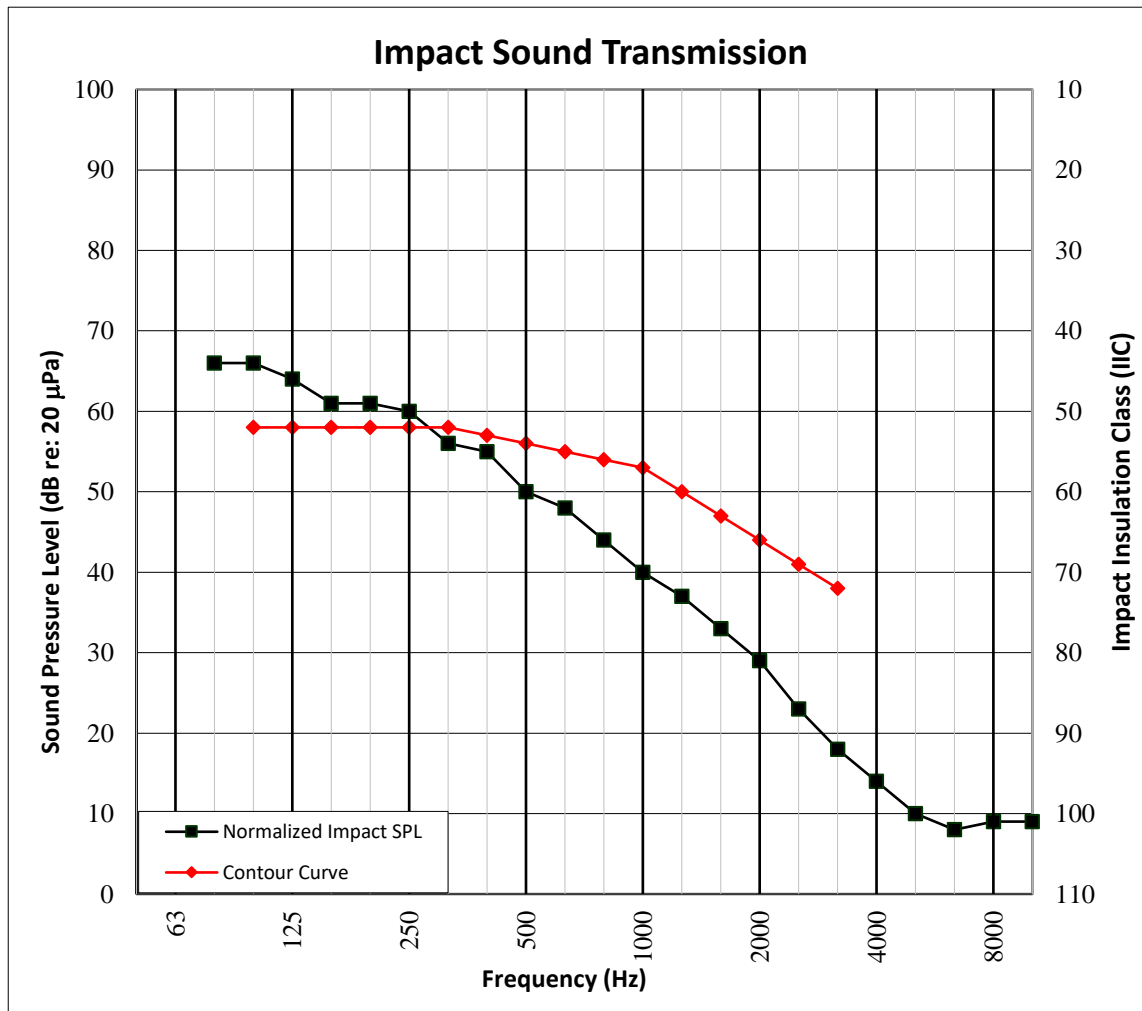

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 14

PHOTOGRAPHS



Photo No. 1

Source Room View of Test Specimen Installation



Photo No. 2

Receive Room View of Test Specimen Installation

TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.10-113-11-R0

Date: 09/11/19

SECTION 15

REVISION LOG

REVISION #	DATE	PAGES	DESCRIPTION
R0	09/11/19	N/A	Original Report Issue - Reissue of Report No. J8051.05-113-11 in the name of Regupol America.