

WORTHINGTON ARMSTRONG VENTURE ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON SHAW COMO LUXURY VINYL TILE - SONUSCLIP
WITH ONE-LAYER GYPSUM BOARD CEILING

SPECIMEN TYPE

Open Web Truss - 457 mm

REPORT NUMBER

J9666.02-113-11-R1

TEST DATE

08/02/19

ISSUE DATE

09/12/19

REVISED DATE

10/18/19

RECORD RETENTION END

08/02/23

PAGES


12

DOCUMENT CONTROL

ATI 00629 (03/21/18)

RTTDS-R-AMER-Test-2844

© 2017 INTERTEK

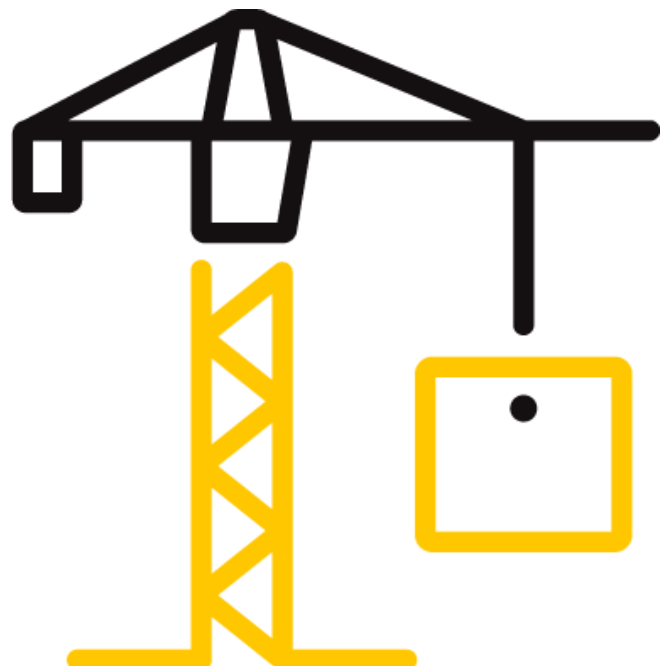

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

REPORT ISSUED TO

WORTHINGTON ARMSTRONG VENTURE

101 Lindenwood Drive Suite 350

Malvern, Pennsylvania 19355

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by Worthington Armstrong Venture to perform testing in accordance with ASTM E90 AND ASTM E492 on Shaw Como Luxury Vinyl Tile - SonusClip with One-Layer Gypsum Board Ceiling. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2

SUMMARY OF TEST RESULTS

DATA FILE NO.	J9666.02
SERIES/MODEL:	Shaw Como Luxury Vinyl Tile - SonusClip with One-Layer Gypsum Board Ceiling
STC	61
IIC	57

COMPLETED BY: Morgan S. J. Kennedy
Technician - Acoustical
TITLE: Testing
SIGNATURE:
DATE: 10/18/19

COMPLETED BY: Jordan Strybos
Engineer, Team Lead -
TITLE: Acoustical Testing
SIGNATURE:
DATE: 10/18/19

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.



TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 3**TEST METHODS**

The specimen was evaluated in accordance with the following:

ASTM E90-09 (2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*

ASTM E413-16, *Classification for Rating Sound Insulation*

ASTM E492-09(2016)e1, *Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine*

ASTM E989-18, *Classification for Determination of Impact Insulation Class (IIC)*

ASTM E2235-04 (2012), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

SECTION 4**MATERIAL SOURCE/INSTALLATION**

The full test specimen was assembled on the day of testing by B&C. All materials provided by the client were installed on an existing B&C assembly (Open Web Truss - 457 mm) utilizing B&C-supplied materials. The assembly was installed in a steel test frame which was installed into the opening between the source and receive rooms in the test chamber. The test frame was isolated from the structure with dense neoprene gasket.

The total weight of the floor/ceiling assembly was 1007.8 kg. B&C will store samples of the test specimen for four years. Photographs of the test specimen are included in the report. The client did not supply drawings of the test specimen.

B&C will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by B&C for the entire test record retention period.

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

**SECTION 5
EQUIPMENT**

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	INT00977	08/18 *
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	65124	05/18 *
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	63763-1	06/18 *
Microphone Calibrator	Norsonic	1251	Pistonphone Calibrator	65105	06/19
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63741	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63739	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	67340	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63746	09/18
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	65617	06/19
Receive Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63810	10/18
				63811	10/18
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65029	03/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65586	02/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT01089	01/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00652	01/19
Source Room Microphone	PCB Electronics	378C20	Microphone and Preamplifier	63742	03/19
Source Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63812	10/18
Tapping Machine	Norsonic	Nor277	Tapping Machine	INT00936	12/18

* The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

VT RECEIVE ROOM VOLUME	155.77 m ³
VT SOURCE ROOM VOLUME	190 m ³

**SECTION 6
LIST OF OFFICIAL OBSERVERS**

NAME	COMPANY
Seth J. Allen	Intertek B&C
Jordan Strybos	Intertek B&C

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 7**TEST PROCEDURE**

The microphones were calibrated before conducting the tests. The air temperature and relative humidity conditions were monitored and recorded during all measurements. The average temperature and humidity of both the source and received rooms are listed in Sections 10 and 11. The maximum and minimum temperatures and humidities of the receive room from the duration of the test are listed in Sections 12 and 13.

The airborne transmission loss test was conducted in accordance with the ASTM E90 test method using the single direction method. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Two sound pressure level measurements were made simultaneously in both rooms, at each of five microphone positions.

The impact sound transmission test was conducted in accordance with the ASTM E492 test method. Two background noise sound pressure level, two sound pressure level measurements with the tapping machine operating at each position specified by ASTM E492, and five sound absorption measurements were conducted at each of five microphone positions.

Detailed test procedures, data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

SECTION 8**TEST CALCULATIONS**

The STC (Sound Transmission Class) and IIC (Impact Insulation Class) ratings were calculated in accordance with ASTM E413 and ASTM E989, respectively.

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 9

TEST SPECIMEN DESCRIPTION

MATERIAL	DIMENSIONS (mm)	THICKNESS (mm)	MANUFACTURER AND SERIES	QUANTITY	AVERAGE WEIGHT
Luxury Vinyl Plank	1220 by 150	5.5	Shaw Como	10.98 m ²	6.2 kg/m ²
	Note: Loose laid				
Gypsum Underlayment	3023 by 3632	25.4	Formulated Materials Treadstone™ FR25	10.98 m ²	45.85 kg/m ²
	Note: Poured directly onto the subfloor underlayment, cured a minimum of 14 days. The gypsum panel had a closed cell foam perimeter isolation. No noticeable shrinkage or cracking was visible on the specimen.				
Oriented Strand Board Sheathing	1219 by 2438	18.8	N/A	10.98 m ²	13.82 kg/m ²
	Note: Fastened to trusses with 76 mm by 3 mm framing nails on 203 mm centers along perimeter and 305 mm centers in the field.				
Fiberglass Insulation	520.7 by 3023	88.9	Johns Manville Unfaced R-13	10.98 m ²	1.32 kg/m ²
	Note: Installed over drywall grid cross tees				
Open Web Truss	88.9 by 2934	457.2	York PB Truss L/360	7 trusses	19.05 kg/truss
	Note: Installed on 610 mm centers using JUS414 hanger brackets.				
Resilient Sound Isolation Clip	38.1 by 44.5	111.1	Regupol® SonusClip 90DE™	12 clips	0.08 kg/clip
	Note: Attached to the bottom of the trusses in a 1219 mm by 1219 mm grid pattern				
Drywall Main Beam	38.1 by 2870	43.0	Armstrong HD8906IIC	10.9 lin m	0.45 kg/m
	Note: The main beams were attached directly to the Regupol SonusClips creating a 153 mm plenum. The measured steel thickness was 0.5 mm.				
Cross Tee	38.3 by 1219	37.3	Armstrong XL8945P	27.2 lin m	0.45 kg/m
	Note: Inserted into the main beams on 406 mm centers. The measured steel thickness was 0.5 mm.				
Gypsum Panel	3023 by 1219	15.9	National Gypsum Gold Bond® Fire-Shield® Type X	10.56 m ²	11.23 kg/m ²
	Note: Fastened with 25.4 mm fine thread drywall screws on 305 mm centers. Seams and perimeter sealed with Pecora AC-20® Acoustical Sealant and covered with pressure-sensitive tape.				

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 10

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS



TEST DATE	8/2/2019				
DATA FILE NO.	J9666.02				
CLIENT	Worthington Armstrong Venture				
DESCRIPTION	5.5 mm Shaw Como Luxury Vinyl Plank, 25.4 mm Formulated Materials Treadstone™ FR25 Gypsum Underlayment, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 111.1 mm Regupol® SonusClip 90DE™ Resilient Sound Isolation Clip, 43 mm Armstrong HD8906IIC Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	22.3°C	Source Temp.	20.2°C
TECHNICIAN	SJA	Receive Humidity	71%	Source Humidity	71%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
80	42.7	16.5	105	64	41	2.4	-
100	29.9	9.7	105	67	40	2.4	-
125	31.2	10.2	102	61	43	1.6	2
160	32.0	9.1	101	60	43	0.7	5
200	24.5	9.5	105	58	49	1.5	2
250	20.9	9.5	104	55	51	0.8	3
315	22.3	9.8	103	53	51	0.8	6
400	18.3	7.9	104	51	56	0.8	4
500	19.9	7.9	103	46	60	0.6	1
630	22.3	7.5	104	45	61	0.5	1
800	21.2	7.6	104	43	63	0.5	0
1000	18.7	7.8	103	41	64	0.4	0
1250	16.7	7.7	103	39	67	0.3	0
1600	13.5	7.9	103	37	68	0.4	0
2000	12.4	8.6	103	36	68	0.4	0
2500	11.1	9.8	101	35	68	0.3	0
3150	10.2	10.5	102	31	73	0.4	0
4000	11.0	11.5	103	28	75	0.6	0
5000	10.3	13.0	102	25	78	0.5	-
6300	7.9	15.6	96	15	81	0.6	-
8000	7.3	20.2	96	11	83	0.9	-
10000	7.2	20.2	91	7	83	0.8	-
STC Rating	61	<i>(Sound Transmission Class)</i>			Sum of Deficiencies	24	

- Notes:**
- 1) Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.
 - 2) Specimen TL levels listed in red are potentially limited by the laboratory flanking limit.
 - 3) Specimen TL levels listed in blue indicate the lower limit of the transmission loss.
 - 4) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1


Date: 10/18/19

SECTION 11

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS GRAPH



TEST DATE	8/2/2019				
DATA FILE NO.	J9666.02				
CLIENT	Worthington Armstrong Venture				
DESCRIPTION	5.5 mm Shaw Como Luxury Vinyl Plank, 25.4 mm Formulated Materials Treadstone™ FR25 Gypsum Underlayment, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 111.1 mm Regupol® SonusClip 90DE™ Resilient Sound Isolation Clip, 43 mm Armstrong HD8906IIC Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	22.3°C	Source Temp.	20.2°C
TECHNICIAN	SJA	Receive Humidity	71%	Source Humidity	71%

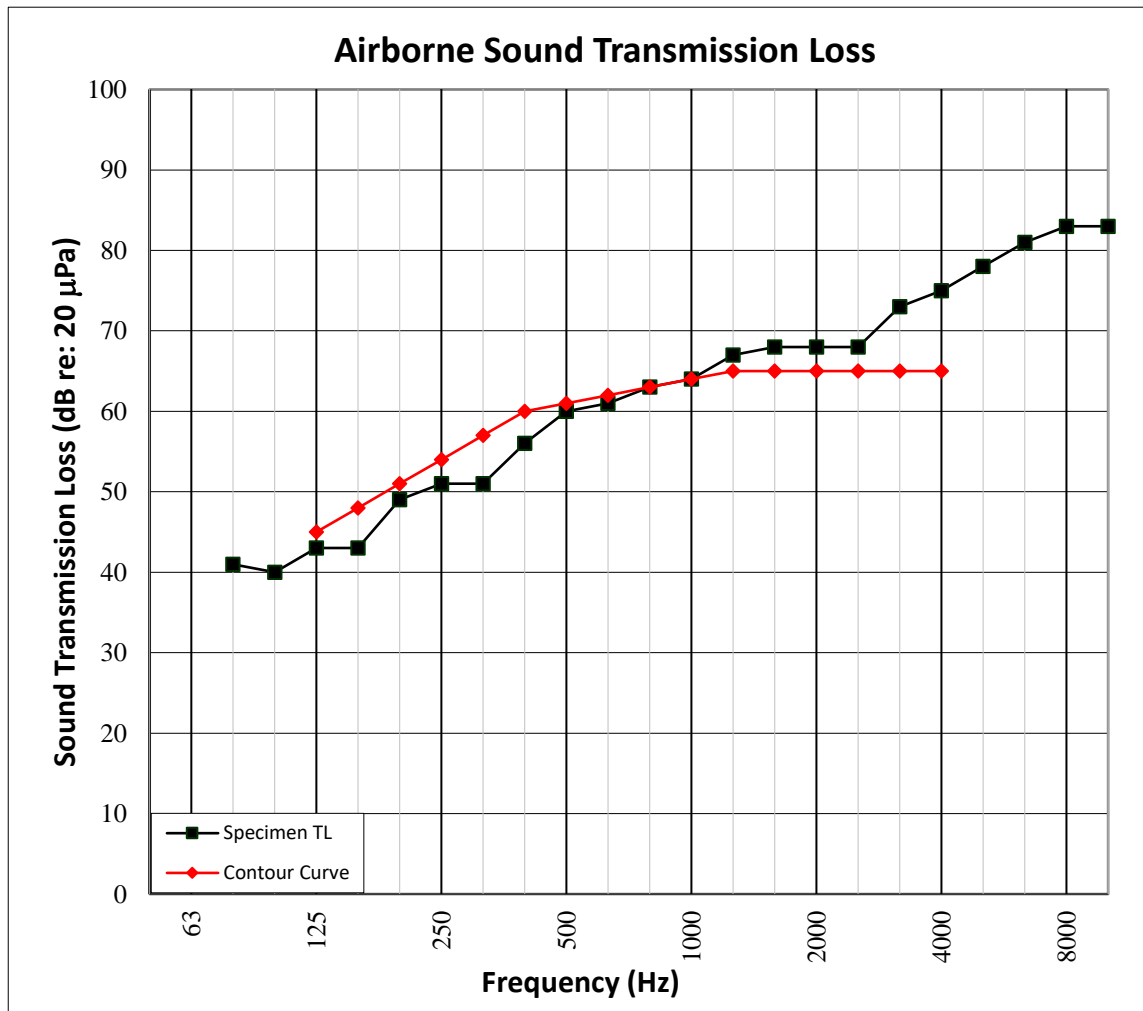

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 12

TEST RESULTS - IMPACT SOUND TRANSMISSION



TEST DATE	8/2/2019				
DATA FILE NO.	J9666.02				
CLIENT	Worthington Armstrong Venture				
DESCRIPTION	5.5 mm Shaw Como Luxury Vinyl Plank, 25.4 mm Formulated Materials Treadstone™ FR25 Gypsum Underlayment, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 111.1 mm Regupol® SonusClip 90DE™ Resilient Sound Isolation Clip, 43 mm Armstrong HD8906IIC Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	22.3°C	Minimum Temp.	22.3°C
TECHNICIAN	SJA	Max. Humidity	71%	Min. Humidity	71%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	NORMALIZED IMPACT SPL (dB)	95% CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
80	43.6	17.8	61	1.4	-
100	31.8	9.6	58	1.2	3
125	30.7	10.6	59	1.0	4
160	30.1	9.3	60	0.8	5
200	22.1	9.3	59	0.5	4
250	20.0	9.6	59	0.6	4
315	21.7	9.7	59	0.5	4
400	17.9	7.8	57	0.4	3
500	18.9	7.9	55	0.3	2
630	21.3	7.5	54	0.2	2
800	21.4	7.6	51	0.2	0
1000	19.0	7.8	48	0.2	0
1250	17.2	7.8	44	0.2	0
1600	14.7	7.9	43	0.3	0
2000	13.4	8.6	42	0.2	1
2500	11.3	9.8	38	0.3	0
3150	10.7	10.6	26	0.3	0
4000	11.3	11.4	16	0.6	-
5000	11.0	12.9	10	0.6	-
6300	9.2	15.0	8	0.5	-
8000	7.8	19.9	9	0.7	-
10000	7.3	19.9	9	1.0	-
IIC Rating	57	<i>(Impact Insulation Class)</i>		Sum of Deficiencies	32

Notes: Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1


Date: 10/18/19

SECTION 13

TEST RESULTS - IMPACT SOUND TRANSMISSION GRAPH



TEST DATE	8/2/2019				
DATA FILE NO.	J9666.02				
CLIENT	Worthington Armstrong Venture				
DESCRIPTION	5.5 mm Shaw Como Luxury Vinyl Plank, 25.4 mm Formulated Materials Treadstone™ FR25 Gypsum Underlayment, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 111.1 mm Regupol® SonusClip 90DE™ Resilient Sound Isolation Clip, 43 mm Armstrong HD8906IIC Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	22.3°C	Minimum Temp.	22.3°C
TECHNICIAN	SJA	Max. Humidity	71%	Min. Humidity	71%

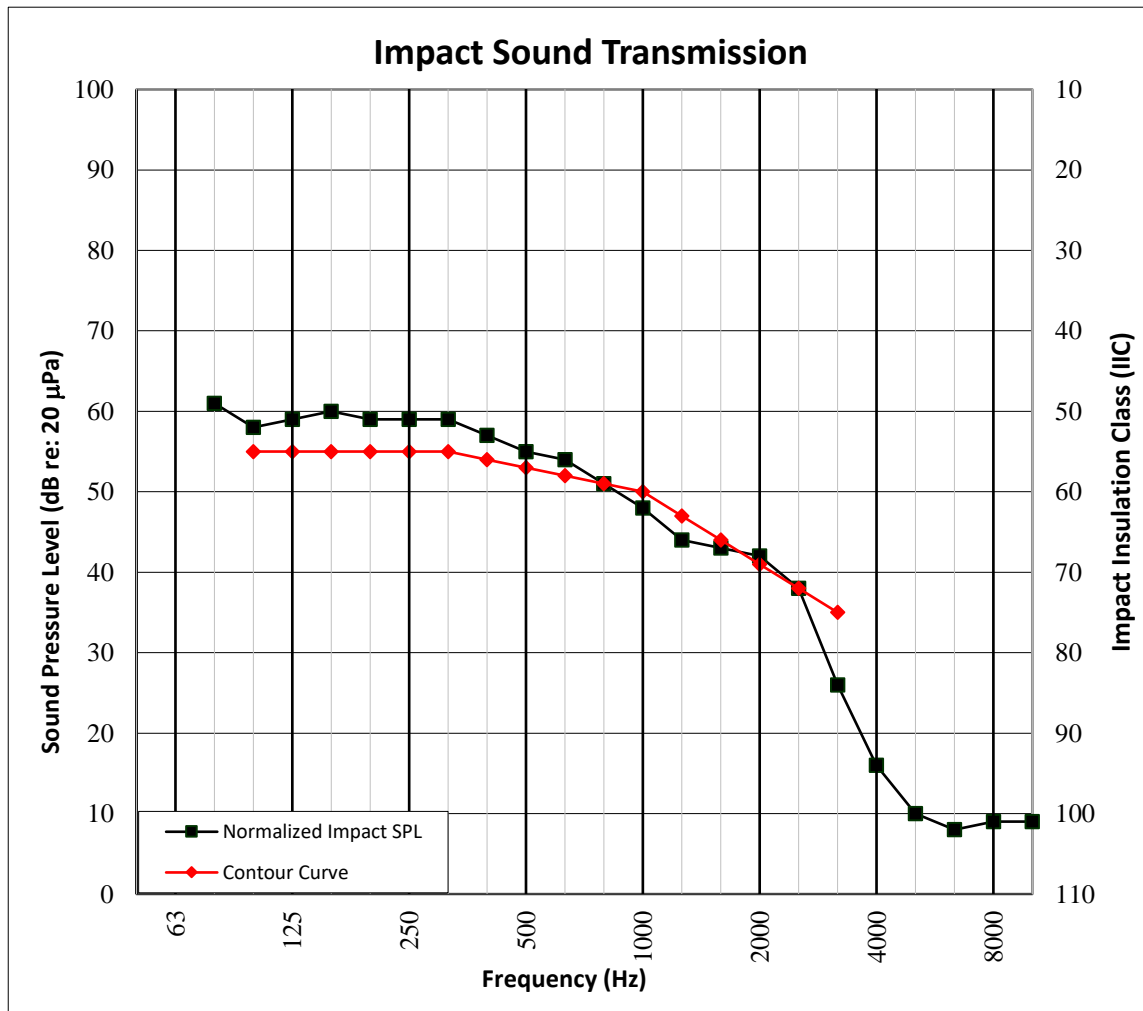

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 14

PHOTOGRAPHS



Photo No. 1

Source Room View of Test Specimen Installation



Photo No. 2

Receive Room View of Test Specimen Installation

TEST REPORT FOR WORTHINGTON ARMSTRONG VENTURE

Report No.: J9666.02-113-11-R1

Date: 10/18/19

SECTION 15

REVISION LOG

REVISION #	DATE	PAGES	DESCRIPTION
R0	09/12/19	N/A	Original Report Issue
R1	10/18/19	Page 6	Corrected Insulation Note