

# REGUPOL AMERICA

# ACOUSTICAL

# PERFORMANCE

# TEST REPORT

## SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON CERAMIC TILE WITH REGUPOL SONUS  
UNDERLAYMENT - AMERIFORM NOCOM STRUCTURAL MAGNESIUM BOARD

## SPECIMEN TYPE

254 mm Steel C-Joist Assembly with Regupol® SonusClip™ Sound Isolation Clip and  
Two-Layer Ceiling

## REPORT NUMBER

J8051.12-113-11-R0

## TEST DATE

06/30/19

## ISSUE DATE

07/09/19

## RECORD RETENTION END


06/30/23

## PAGES

12

## DOCUMENT CONTROL

ATI 00629 (03/21/18)  
RTTDS-R-AMER-Test-2844  
© 2017 INTERTEK

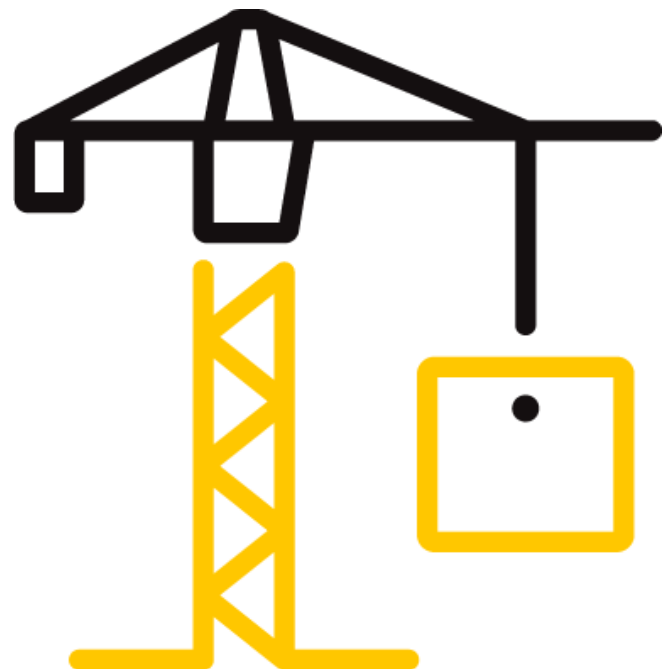

## TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.12-113-11-R0

Date: 09/11/19

### REPORT ISSUED TO

#### REGUPOL AMERICA

11 Ritter Way

Lebanon, Pennsylvania 17042

### SECTION 1

#### SCOPE

Intertek Building & Construction (B&C) was contracted to perform testing in accordance with ASTM E90 AND ASTM E492 on Ceramic Tile with Regupol Sonus Underlayment - Ameriform NOCOM Structural Magnesium Board. This report is a reissue in the name of Regupol America through written authorization from the original report holder. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

### SECTION 2

#### SUMMARY OF TEST RESULTS

<b>DATA FILE NO.</b>	J8051.08
<b>SERIES/MODEL:</b>	Ceramic Tile with Regupol Sonus Underlayment - Ameriform NOCOM Structural Magnesium Board
<b>STC</b>	61
<b>IIC</b>	58

**COMPLETED BY:** David M. Dacheux III  
Technician - Acoustical  
**TITLE:** Testing  
**SIGNATURE:**  
**DATE:** 09/11/19

**COMPLETED BY:** Jordan Strybos  
Engineer, Team Lead -  
**TITLE:** Acoustical Testing  
**SIGNATURE:**  
**DATE:** 09/11/19

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.



**TEST REPORT FOR REGUPOL AMERICA**

Report No.: J8051.12-113-11-R0

Date: 09/11/19

**SECTION 3****TEST METHODS**

The specimen was evaluated in accordance with the following:

**ASTM E90-09 (2016)**, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*

**ASTM E413-16**, *Classification for Rating Sound Insulation*

**ASTM E492-09(2016)e1**, *Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine*

**ASTM E989-18**, *Classification for Determination of Impact Insulation Class (IIC)*

**ASTM E2235-04 (2012)**, *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

**SECTION 4****MATERIAL SOURCE/INSTALLATION**

The full test specimen was assembled on the day of testing by B&C. All materials provided by the original client were installed on an existing B&C assembly (254 mm Steel C-Joist Assembly with Regupol® SonusClip™ Sound Isolation Clip and Two-Layer Ceiling) utilizing B&C-supplied materials. The assembly was installed in a steel test frame which was installed into the opening between the source and receive rooms in the test chamber. The test frame was isolated from the structure with dense neoprene gasket.

The total weight of the floor/ceiling assembly was 796.7 kg. B&C will store samples of the test specimen for four years. Photographs of the test specimen are included in the report. The client did not supply drawings of the test specimen.

This report is reissued in the name of Regupol America through written authorization from the original report holder. The original Report No. is J8051.08-113-11.

B&C will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by B&C for the entire test record retention period.

**TEST REPORT FOR REGUPOL AMERICA**

Report No.: J8051.12-113-11-R0

Date: 09/11/19

**SECTION 5  
EQUIPMENT**

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	INT00977	08/18 *
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	65124	05/18 *
Data Acquisition Unit	National Instruments	PXI-4462	Data Acquisition Card	63763-1	06/18 *
Microphone Calibrator	Larson Davis	CAL200	Acoustical Calibrator	INT00852	09/18
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63741	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63739	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	67340	04/19
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63746	09/18
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63747	07/18
Receive Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63810	10/18
				63811	10/18
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65029	03/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65586	02/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT01089	01/19
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00652	01/19
Source Room Microphone	PCB Electronics	378C20	Microphone and Preamplifier	63742	03/19
Source Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63812	10/18
Tapping Machine	Norsonic	Nor277	Tapping Machine	INT00936	12/18

\* The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

<b>VT RECEIVE ROOM VOLUME</b>	156.8 m <sup>3</sup>
<b>VT SOURCE ROOM VOLUME</b>	190 m <sup>3</sup>

**SECTION 6  
LIST OF OFFICIAL OBSERVERS**

NAME	COMPANY
Michael K. Daniel	Intertek B&C
Seth J. Allen	Intertek B&C

**TEST REPORT FOR REGUPOL AMERICA**

Report No.: J8051.12-113-11-R0

Date: 09/11/19

**SECTION 7****TEST PROCEDURE**

The microphones were calibrated before conducting the tests. The air temperature and relative humidity conditions were monitored and recorded during all measurements. The average temperature and humidity of both the source and received rooms are listed in Sections 10 and 11. The maximum and minimum temperatures and humidities of the receive room from the duration of the test are listed in Sections 12 and 13.

The airborne transmission loss test was conducted in accordance with the ASTM E90 test method using the single direction method. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Two sound pressure level measurements were made simultaneously in both rooms, at each of five microphone positions.

The impact sound transmission test was conducted in accordance with the ASTM E492 test method. Two background noise sound pressure level, two sound pressure level measurements with the tapping machine operating at each position specified by ASTM E492, and five sound absorption measurements were conducted at each of five microphone positions.

Detailed test procedures, data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

**SECTION 8****TEST CALCULATIONS**

The STC (Sound Transmission Class) and IIC (Impact Insulation Class) ratings were calculated in accordance with ASTM E413 and ASTM E989, respectively.

**TEST REPORT FOR REGUPOL AMERICA**

Report No.: J8051.12-113-11-R0

Date: 09/11/19

**SECTION 9**

**TEST SPECIMEN DESCRIPTION**

MATERIAL	DIMENSIONS (mm)	THICKNESS (mm)	MANUFACTURER AND SERIES	QUANTITY	AVERAGE WEIGHT
Ceramic Tile	304.8 by 304.8	8.0	Daltile	10.98 m <sup>2</sup>	15.87 kg/m <sup>2</sup>
	Note: Keracolor Sanded Tile Grout was placed into the 6.35 mm joints between the ceramic tile and wiped clean. The ceramic tile was placed with light pressure onto a bed of MAPEI mortar meeting ANSI A118.11 and A118.15. The mortar was set using a 19 mm by 10 mm by 14 mm trowel. Both the grout and mortar were allowed to cure to manufacturer's specifications.				
Rubber Underlayment	3048 by 1219	5.0	Regupol Sonus	10.98 m <sup>2</sup>	4.3 kg/m <sup>2</sup>
	Note: Loose laid				
Structural Magnesium Board	1219 by 2438	19.2	Ameriform NOCOM	10.98 m <sup>2</sup>	19.82 kg/m <sup>2</sup>
	Note: Fastened to the floor joists with 41 mm #8 screws spaced on 152.4 mm centers along the perimeter and on 406.4 mm centers in the field				
Fiberglass Insulation	2940 by 406	88.9	Knauf EcoBatt®	10.98 m <sup>2</sup>	1.03 kg/m <sup>2</sup>
	Note: Laid directly over resilient channels				
Steel C-Joist	3023 by 41.3	254.0	ClarkDietrich S162	6 joists	11.6 kg/joist
	Note: Installed on 610 mm centers using JUS414 hanger brackets				
Resilient Sound Isolation Clip	76.2 by 36.5	31.8	Regupol® SonusClip™	24 clips	0.06 kg/clip
	Note: Installed in a 610 mm by 1219 mm grid pattern				
Furring/Hat Channel	3658 by 76.2	22.3	ClarkDietrich 087F125-18	29.1 lin m	0.48 kg/m
	Note: Installed into the isolation clips, spaced 610 mm on center				
Gypsum Panel	1219 by 3023	15.9	USG SHEETROCK® Brand FIRECODE® C Core	10.98 m <sup>2</sup>	11.91 kg/m <sup>2</sup>
	Note: Fastened to the channels on 305 mm centers with 25.4 mm Type S bugle head screws. The seams of the gypsum panels were sealed with Pecora AC-20 FTR caulk and covered with pressure sensitive tape.				
Gypsum Panel	1219 by 3023	15.9	USG SHEETROCK® Brand FIRECODE® C Core	10.98 m <sup>2</sup>	11.91 kg/m <sup>2</sup>
	Note: Fastened to the channels on 305 mm centers with 41.3 mm Type S bugle head screws. The seams of the gypsum panels were sealed with Pecora AC-20 FTR caulk and covered with pressure sensitive tape.				

## TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.12-113-11-R0

Date: 09/11/19

### SECTION 10

### TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS



<b>TEST DATE</b>	6/30/2019				
<b>DATA FILE NO.</b>	J8051.08				
<b>CLIENT</b>	Regupol America				
<b>DESCRIPTION</b>	8 mm Daltile Ceramic Tile, 5 mm Regupol Sonus Rubber Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
<b>SPECIMEN AREA</b>	10.98 m <sup>2</sup>	<b>Receive Temp.</b>	20.4°C	<b>Source Temp.</b>	20.8°C
<b>TECHNICIAN</b>	MKD	<b>Receive Humidity</b>	58%	<b>Source Humidity</b>	58%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m <sup>2</sup>	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
80	35.2	18.0	107	64	42	2.0	-
100	28.9	15.0	105	66	39	1.9	-
125	31.9	11.5	103	61	43	1.3	2
160	33.1	10.0	106	63	45	1.6	3
200	24.6	10.6	102	56	47	1.5	4
250	21.7	11.2	101	52	50	0.9	4
315	22.4	10.4	105	51	55	0.9	2
400	18.0	9.4	102	48	56	0.5	4
500	18.8	8.9	102	47	58	0.6	3
630	21.9	8.6	103	45	60	0.6	2
800	21.6	8.8	103	42	62	0.5	1
1000	22.3	9.1	102	41	62	0.6	2
1250	18.9	8.9	103	40	64	0.4	1
1600	14.9	8.8	103	39	65	0.5	0
2000	13.7	9.8	103	37	67	0.4	0
2500	11.6	10.5	101	34	68	0.4	0
3150	10.9	11.3	102	31	72	0.6	0
4000	11.3	12.3	102	29	73	0.6	0
5000	10.7	14.1	102	26	76	0.5	-
6300	9.1	17.2	96	16	79	0.9	-
8000	11.5	22.2	95	12	82	0.8	-
10000	10.6	22.2	90	7	81	0.7	-
<b>STC Rating</b>	<b>61</b>	<i>(Sound Transmission Class)</i>			<b>Sum of Deficiencies</b>	<b>28</b>	

- Notes:**
- 1) Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.
  - 2) Specimen TL levels listed in red are potentially limited by the laboratory flanking limit.
  - 3) Specimen TL levels listed in blue indicate the lower limit of the transmission loss.
  - 4) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

## TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.12-113-11-R0


Date: 09/11/19

### SECTION 11

### TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS GRAPH



<b>TEST DATE</b>	6/30/2019				
<b>DATA FILE NO.</b>	J8051.08				
<b>CLIENT</b>	Regupol America				
<b>DESCRIPTION</b>	8 mm Daltile Ceramic Tile, 5 mm Regupol Sonus Rubber Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
<b>SPECIMEN AREA</b>	10.98 m <sup>2</sup>	<b>Receive Temp.</b>	20.4°C	<b>Source Temp.</b>	20.8°C
<b>TECHNICIAN</b>	MKD	<b>Receive Humidity</b>	58%	<b>Source Humidity</b>	58%

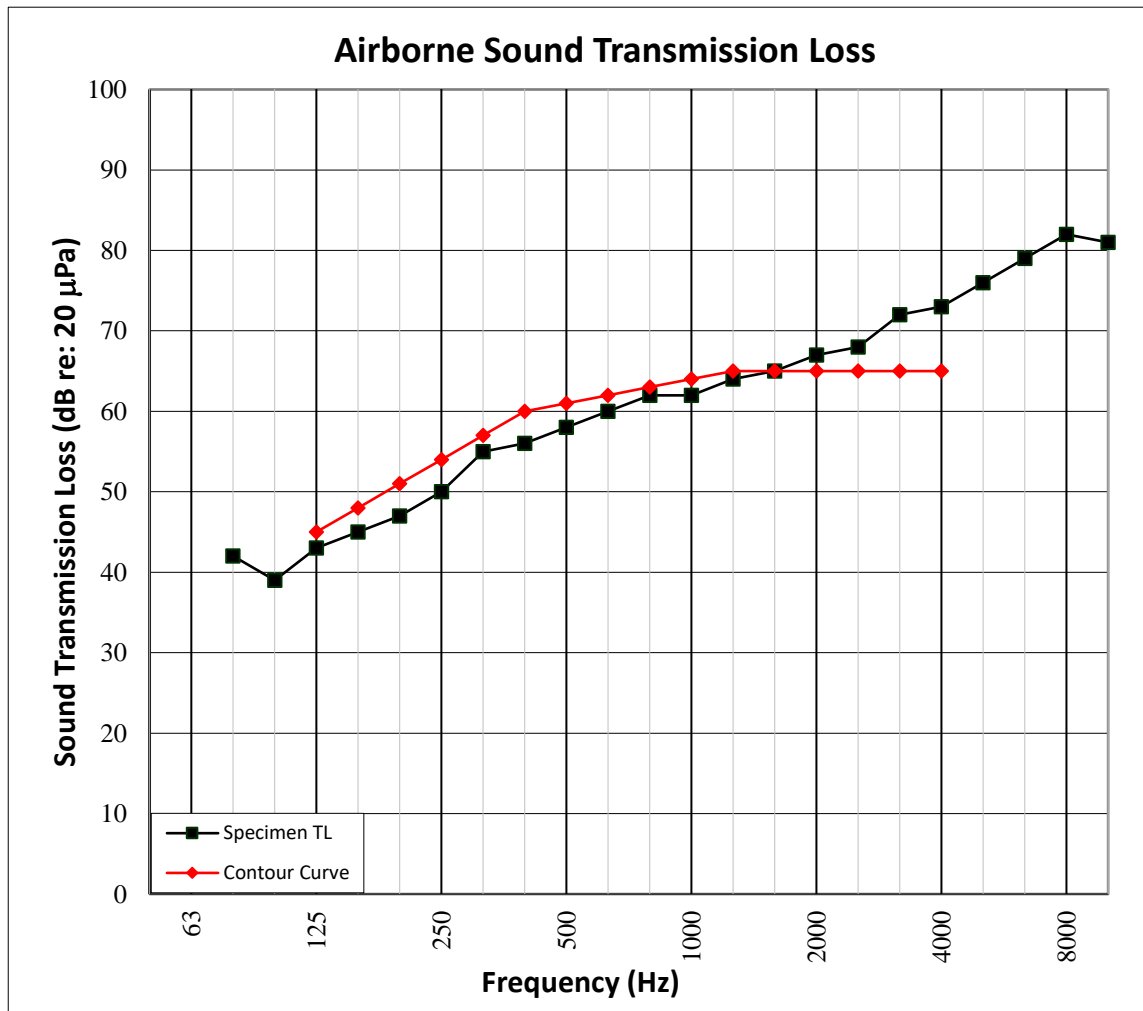



## TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.12-113-11-R0

Date: 09/11/19

### SECTION 12

#### TEST RESULTS - IMPACT SOUND TRANSMISSION



<b>TEST DATE</b>	6/30/2019				
<b>DATA FILE NO.</b>	J8051.08				
<b>CLIENT</b>	Regupol America				
<b>DESCRIPTION</b>	8 mm Daltile Ceramic Tile, 5 mm Regupol Sonus Rubber Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
<b>SPECIMEN AREA</b>	10.98 m <sup>2</sup>	<b>Maximum Temp.</b>	20.6°C	<b>Minimum Temp.</b>	20.2°C
<b>TECHNICIAN</b>	MKD	<b>Max. Humidity</b>	59%	<b>Min. Humidity</b>	58%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m <sup>2</sup>	NORMALIZED IMPACT SPL (dB)	95% CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
80	35.5	18.4	58	1.3	-
100	28.6	15.5	57	1.3	3
125	32.2	11.7	56	1.7	2
160	33.0	10.4	57	1.1	3
200	24.8	9.9	57	0.5	3
250	21.7	10.9	58	0.7	4
315	21.3	10.3	55	0.3	1
400	17.4	9.5	55	0.5	2
500	17.3	8.5	55	0.3	3
630	23.7	8.8	54	0.2	3
800	21.8	9.0	51	0.2	1
1000	20.4	9.0	49	0.3	0
1250	17.9	8.8	47	0.3	1
1600	12.3	8.8	43	0.3	0
2000	11.5	9.7	39	0.3	0
2500	8.5	10.4	32	0.2	0
3150	7.5	11.3	26	0.3	0
4000	6.8	12.5	20	0.4	-
5000	6.2	14.2	15	0.6	-
6300	6.4	17.2	9	0.3	-
8000	6.7	22.4	9	0.3	-
10000	7.1	22.4	9	0.4	-
<b>IIC Rating</b>	<b>58</b>	<i>(Impact Insulation Class)</i>		<b>Sum of Deficiencies</b>	<b>26</b>

**Notes:** Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

## TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.12-113-11-R0


Date: 09/11/19

### SECTION 13

### TEST RESULTS - IMPACT SOUND TRANSMISSION GRAPH



<b>TEST DATE</b>	6/30/2019				
<b>DATA FILE NO.</b>	J8051.08				
<b>CLIENT</b>	Regupol America				
<b>DESCRIPTION</b>	8 mm Daltile Ceramic Tile, 5 mm Regupol Sonus Rubber Underlayment, 19.2 mm Ameriform NOCOM Structural Magnesium Board, 88.9 mm Knauf EcoBatt® Fiberglass Insulation, 254 mm ClarkDietrich S162 Steel C-Joist, 31.75 mm Regupol® SonusClip™ Resilient Sound Isolation Clip, 22.3 mm ClarkDietrich 087F125-18 Furring/Hat Channel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel, 15.9 mm USG SHEETROCK® Brand FIRECODE® C Core Gypsum Panel				
<b>SPECIMEN AREA</b>	10.98 m <sup>2</sup>	<b>Maximum Temp.</b>	20.6°C	<b>Minimum Temp.</b>	20.2°C
<b>TECHNICIAN</b>	MKD	<b>Max. Humidity</b>	59%	<b>Min. Humidity</b>	58%

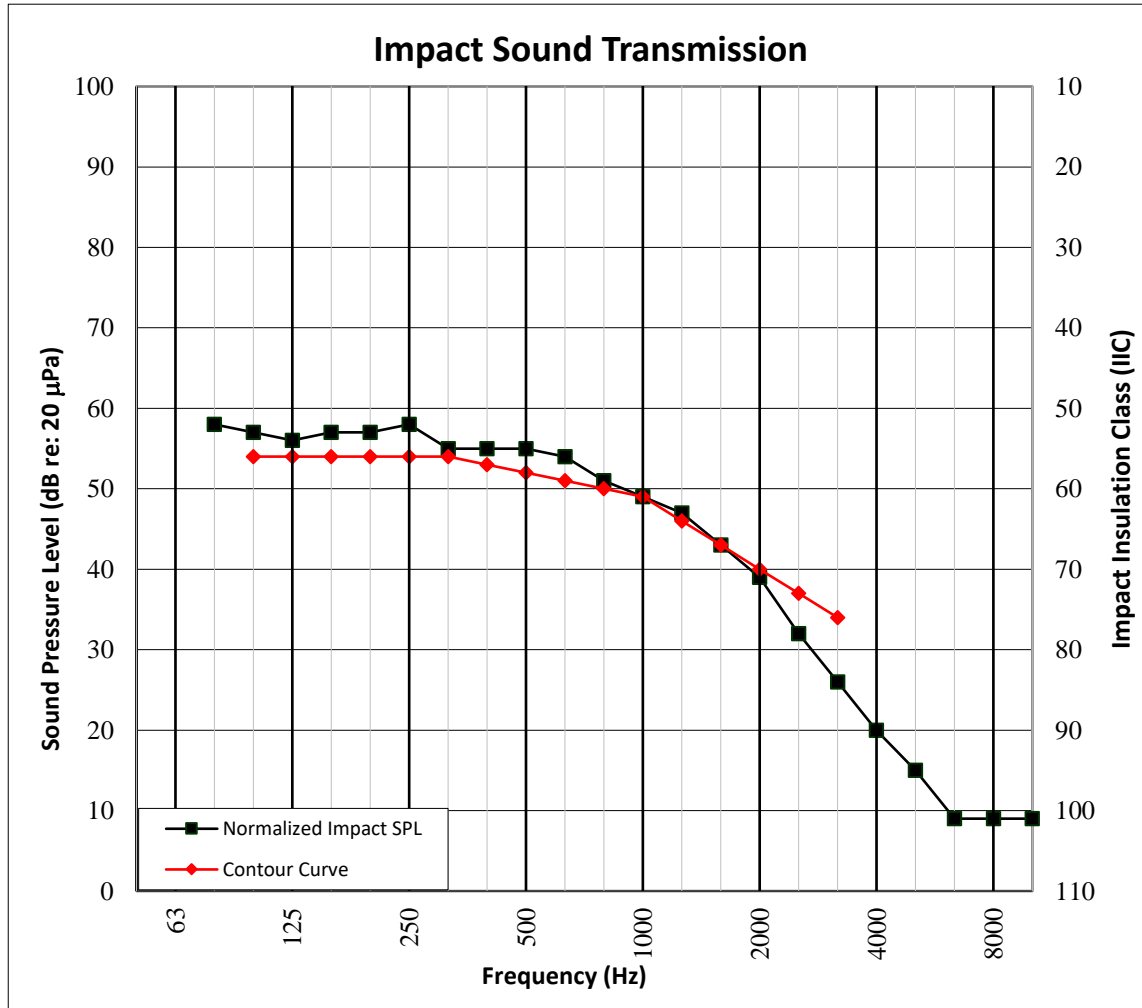

## TEST REPORT FOR REGUPOL AMERICA

Report No.: J8051.12-113-11-R0

Date: 09/11/19

### SECTION 14

#### PHOTOGRAPHS



Photo No. 1

Source Room View of Test Specimen Installation



Photo No. 2

Receive Room View of Test Specimen Installation

**TEST REPORT FOR REGUPOL AMERICA**

Report No.: J8051.12-113-11-R0

Date: 09/11/19

**SECTION 15**

**REVISION LOG**

REVISION #	DATE	PAGES	DESCRIPTION
R0	07/09/19	N/A	Original Report Issue - Reissue of Report No. J8051.08-113-11 in the name of Regupol America.