

Müller-BBM GmbH
Robert-Koch-Str. 11
82152 Planegg bei München

Telephone +49(89)85602 0
Telefax +49(89)85602 111

www.MuellerBBM.de

M. Eng. Philipp Meistring
Telephone +49(89)85602 228
Philipp.Meistring@mbbm.com

2017-08-09
M133001/06 MSG/STEG

Ceramic tiles on support profiles, pedestals Buzon PB-3 and Regupol® sound and drain 22 (layer) – Berleburger Schaumstoffwerk

**Test of the improvement of impact
sound insulation in the ceiling test
facility according to EN ISO 10140-1**

Test Report No. M133001/06

Client:	BSW Berleburger Schaumstoffwerk GmbH Am Hilgenacker 24 57319 Bad Berleburg, Germany Buzon Pedestal International S. A. Prolongement de l'Abbaye, 134 4040 Herstal, Belgium
Consultant:	M. Eng. Philipp Meistring
Date of report:	2017-08-09
Translated version:	2018-03-20
Delivery date of test object:	2017-07-03
Date of test:	2017-07-04
Total number of pages:	19 pages in total, thereof 6 pages of text, 1 page of Appendix A, 3 pages of Appendix B, 2 pages of Appendix C and 7 pages of Appendix D.

Müller-BBM GmbH
HRB Munich 86143
VAT Reg. No. DE812167190

Managing directors:
Joachim Bittner, Walter Grotz,
Dr. Carl-Christian Hantschk, Dr. Alexander Ropertz,
Stefan Schierer, Elmar Schröder

Table of contents

1	Situation and task	3
2	References	3
3	Test setup and test objects	4
4	Test method	5
5	Evaluation	5
6	Measurement results	6
7	Remarks	6

Appendix A: Test certificate

Appendix B: Photos

Appendix C: Drawings

Appendix D: Description of the test method,
of the test facility and equipment used

1 Situation and task

On behalf of the Berleburger Schaumstoffwerk GmbH, 57319 Bad Berleburg, Germany, and Buzon Pedestal International S.A., 4040 Herstal, Belgium, the improvement of the impact sound insulation of a roof terrace covering, consisting of ceramic tiles on support profiles, pedestals of type Buzon PB-3 and impact sound insulation layers of type Regupol® sound and drain 22 (layer) was to be determined in the ceiling test facility on a heavy reference floor according to EN ISO 10140-1 [2].

2 References

This test report is based on the following documents:

- [1] EN ISO 12999-1: Acoustics – Determination and application of measurement uncertainties in building acoustics – Part 1: Sound insulation. May 2014
- [2] EN ISO 10140-1: Acoustics – Laboratory measurement of sound insulation of building elements - Part 1: Application rules for specific products. ISO 10140-1:2016. August 2016.
- [3] EN ISO 10140-2: Laboratory measurement of sound insulation of building elements – Part 2: Measurement of airborne sound insulation. September 2010
- [4] EN ISO 10140-3: Acoustics – Laboratory measurement of sound insulation of building elements – Part 3: Measurement of impact sound insulation. June 2015 (EN ISO 10140-3: 2010 + A1: 2015)
- [5] EN ISO 10140-4: Acoustics – Laboratory measurement of sound insulation of building elements – Part 4: Measurement procedures and requirements. September 2010
- [6] EN ISO 10140-5: Acoustics – Laboratory measurement of sound insulation of building elements – Part 5: Requirements for test facilities and equipment. May 2014 (EN ISO 10140-5: 2010 + A1: 2014)
- [7] EN ISO 717-2: Acoustics – Rating of sound insulation in buildings and of building elements – Part 2: Impact sound insulation. March 2013
- [8] DIN 4109-11: Sound insulation in buildings – Part 11: Verification of sound insulation; Quality and suitability testing. May 2010
- [9] DIN 4109-4: Sound insulation in buildings – Part 4: Testing of acoustics in buildings. July 2016
- [10] EN ISO 3382-2: Acoustics – Measurement of room acoustic parameters – Part 2: Reverberation time in ordinary rooms. September 2009 (EN ISO 3382-2: 2008 + AC: 2009)
- [11] EN 29052-1: Acoustics – Determination of dynamic stiffness – Part 1: Materials used under floating floors in dwellings. June 1992

3 Test setup and test objects

The setup of the test objects in the test facility was carried out by the client.

The test object corresponds to category II according to EN ISO 10140-1 [2].

The test setup can be described as follows (from top to bottom):

- 20 mm Ceramic tiles, size 595 mm x 595 mm x 20 mm; 15.5 kg/tile (44 kg/m²), mounted on system carriers (loosely placed, nominal joint dimension 3 mm)
- 135 mm Air cavity, therein:
 - 42 mm Aluminium support profiles, system Buzon 40/65 mm with 2 EPDM-shim strips 2 mm x 20 mm each, carrier laid in longitudinal direction, centre distance $e = 600$ mm
 - 93 mm Pedestals of Buzon, type PB-3 with Kit2 on the top side with system carrier for support profile, pedestals loosely set up on impact sound insulation layer, laying pattern approx. 600/600 mm
- (2 + 15) mm Impact sound insulation layer Regupol® sound and drain 22 made of PU-bonded rubber fibres (15 mm), on the top side with protective fleece (2 mm), profiled on the bottom side, dynamic stiffness $s'_t \leq 22$ MN/m³ (manufacturer specification)
- 140 mm Reinforced concrete ceiling (heavyweight reference floor according to EN ISO 10140-5, C.2)

The impact sound insulation layer was laid loosely onto the unfinished floor (test ceiling completely covered, butt joints glued). The further construction on top of it was set up with 30 full-size ceramic tiles. Thus a continuous, rectangular area of width x length = 2.99 m x 3.59 m = 10.73 m² was covered by the test setup. Pedestals, support profiles and ceramic tiles were arranged without any contact to the flanking walls.

The dynamic stiffness of the impact sound insulation layer of type Regupol® sound and drain 22 was determined by the test laboratory without preload according to EN 29052-1 [11] as an accompanying test measure. The test was performed on three random samples of the test material (each 200 mm x 200 mm, test including protective fleece covering). The test issued individual values of:

Sample 1: $s'_t = 18$ MN/m³/

Sample 2: $s'_t = 17$ MN/m³/

Sample 3: $s'_t = 16$ MN/m³

(s'_t = apparent dynamic stiffness according to EN 29052-1 [11]).

The manufacturer specification regarding the dynamic stiffness of $s'_t \leq 22 \text{ MN/m}^3$ can thus be confirmed for the test material used.

The test setup was not damaged by the tapping machine.

Appendix B shows photos and Appendix C manufacturer drawings of the test setup.

4 Test method

The test of the impact sound reduction was performed according to EN ISO 10140-1 [2].

The test method, the test facility and the test equipment used are described in Appendix D.

5 Evaluation

The determination of the single values was carried out according to EN ISO 717-2 [7].

The following definitions apply:

- $L_{n, 0, w}$ weighted normalized impact sound pressure level of the reference floor
- $C_{i, 0}$ spectrum adaptation term for the impact sound pressure level of the reference floor
- ΔL_w weighted reduction of impact sound pressure level of the floor covering
- $C_{i, \Delta}$ spectrum adaptation term of the impact sound pressure level of the floor covering
- ΔL_{lin} reduction of impact sound pressure level of the floor covering based on the unweighted linear impact sound pressure $\Delta L_{lin} = \Delta L_w + C_{i, \Delta}$
- $L_{n, r, w}$ weighted normalized impact sound pressure level of the reference floor with the floor covering under test
- $C_{i, r}$ spectrum adaptation term of the reference floor with the floor covering tested

6 Measurement results

The complete measurement results as well as the spectrum adaption terms are indicated in the test certificate in Appendix A.

For the floor structure tested the following result was obtained:

- Weighted reduction of impact sound pressure level $\Delta L_w(C_{i,\Delta}) = 35(-11)$ dB


For the indication of the uncertainty of ΔL_w , an evaluation to one decimal place was added according to EN ISO 717-2 [7] and EN ISO 12999-1 [1]. The evaluation issued the following result:

- Weighted reduction of impact sound pressure level $\Delta L_w = 35.0$ dB \pm 1.1 dB
($k = 1.00$; both sides)

Details on the determination of the indicated uncertainty are given in Appendix D.

7 Remarks

The test results exclusively refer to the conditions given on the day of measurements.



M. Eng. Philipp Meistring
(Project Manager)



Juri Schwezow
(Quality Assurance)

This test report may only be published, shown or copied as a whole, including all of its appendices. The publishing of extracts requires the prior written consent of Müller-BBM GmbH.



Durch die DAKKS Deutsche Akkreditierungsstelle GmbH
nach DIN EN ISO/IEC 17025 akkreditiertes Prüflaboratorium.
Die Akkreditierung gilt für die in der Urkunde aufgeführten Prüfverfahren.

Reduction of impact sound pressure level ISO 10140-1

Laboratory measurement of the reduction of transmitted noise by floor coverings on a heavyweight standard floor

Client: BSW Berleburger Schaumstoffwerk GmbH, 57319 Bad Berleburg, Germany, and Buzon Pedestal International S.A., 4040 Herstal, Belgium

Test specimen: Ceramic tiles on support profiles, pedestals Buzon PB-3 and Regupol® sound and drain 22 (sheet)


Test set up (from top to bottom):

- 20 mm Ceramic tiles, size 595 mm x 595 mm x 20 mm, 15.5 kg/tile (44 kg/m²), mounted on system carriers (loosely placed, nominal joint dimension 3 mm)
- 135 mm Air cavity, therein:
 - 42 mm Aluminium support profiles, system Buzon 40/65 mm with 2 EPDM-shim strips 2 mm x 20 mm each, carriers laid in longitudinal direction, centre distance $e = 600$ mm
 - 93 mm Pedestals of Buzon, type PB-3 with Kit2 on the top side with system carrier for support profile, pedestals loosely set up on impact sound insulation sheet, laying pattern approx. 600/600 mm-
- (2 + 15) mm Impact sound insulation sheet Regupol® sound and drain 22 made of PU-bonded rubber fibres (15 mm), on the top side covered with protective fleece (2 mm), profiled on the bottom side, dynamic stiffness $s'_t \leq 22$ MN/m³ (manufacturer specification)
- 140 mm Reinforced concrete ceiling (heavyweight reference floor according to EN ISO 10140-5, C.2)

Date of test: 2017-07-04
 Source room: B
 Vol.: $V = 46.60$ m³
 Receiving room: A
 Vol.: $V = 49.60$ m³
 $\theta = 22^\circ\text{C}$ r.h. = 48 %

The impact sound insulation sheet was placed loosely onto the unfinished floor (test ceiling completely covered, butt joints glued). The further construction above was set up with 30 full-size ceramic tiles. Thus a continuous, rectangular area of width x length = 2.99 m x 3.59 m = 10.73 m² was covered by the test setup. Pedestals, support profiles and ceramic tiles were arranged without any contact to the flanking walls.

Frequency [Hz]	ΔL 1/3 octave [dB]	$L_{n,0}$ 1/3 octave [dB]
50	12.6	56.1
63	13.8	53.7
80	16.7	65.1
100	15.9	65.1
125	19.9	67.3
160	18.0	64.8
200	18.7	66.9
250	18.9	66.2
315	18.3	66.7
400	24.1	67.4
500	29.3	68.5
630	37.5	68.5
800	34.8	70.3
1000	39.1	71.8
1250	42.6	73.2
1600	38.2	72.4
2000	44.2	73.0
2500	44.4	72.4
3150	47.7	71.4
4000	44.9	69.4
5000	48.4	66.8

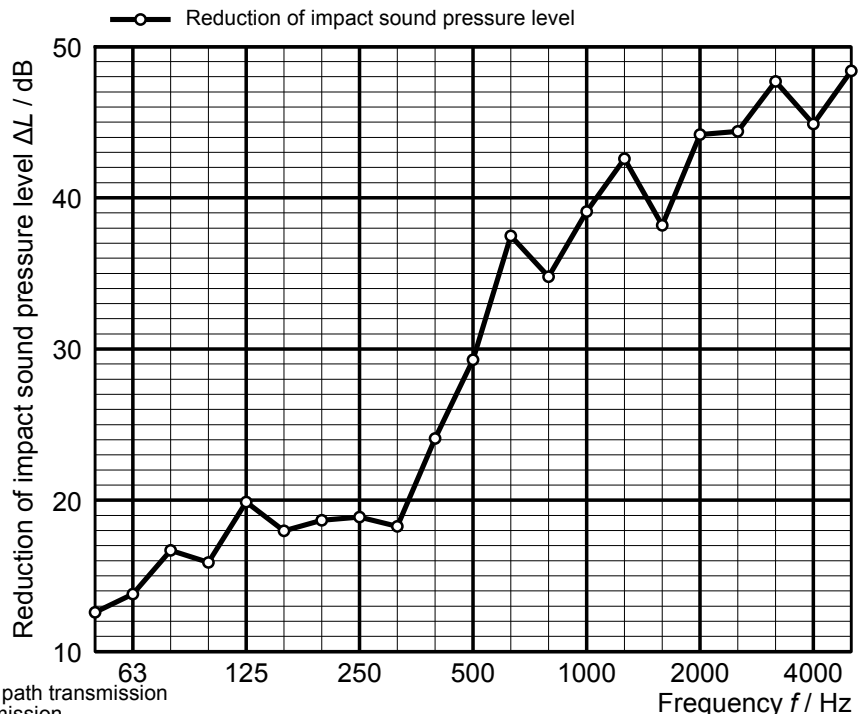

■ minimum value, dominated by indirect path transmission
 □ value corrected for indirect path transmission
 ○ value corrected for background noise

Rating according to ISO 717-2:

Weighted reduction of impact sound pressure level $\Delta L_w(C_{1,\Delta}) = 35(-11)$ dB

These results are based on test made with an artificial source under laboratory conditions (engineering method) $\Delta L_{lin} = 24$ dB $L_{n,0,w}(C_{1,0}) = 79(-12)$ dB $L_{n,r,w}(C_{1,r}) = 43(0)$ dB

Ceramic tiles on support profiles and pedestals



Figure B.1. Laying of the impact sound insulation layers Regupol® sound and drain 22 on the concrete floor.

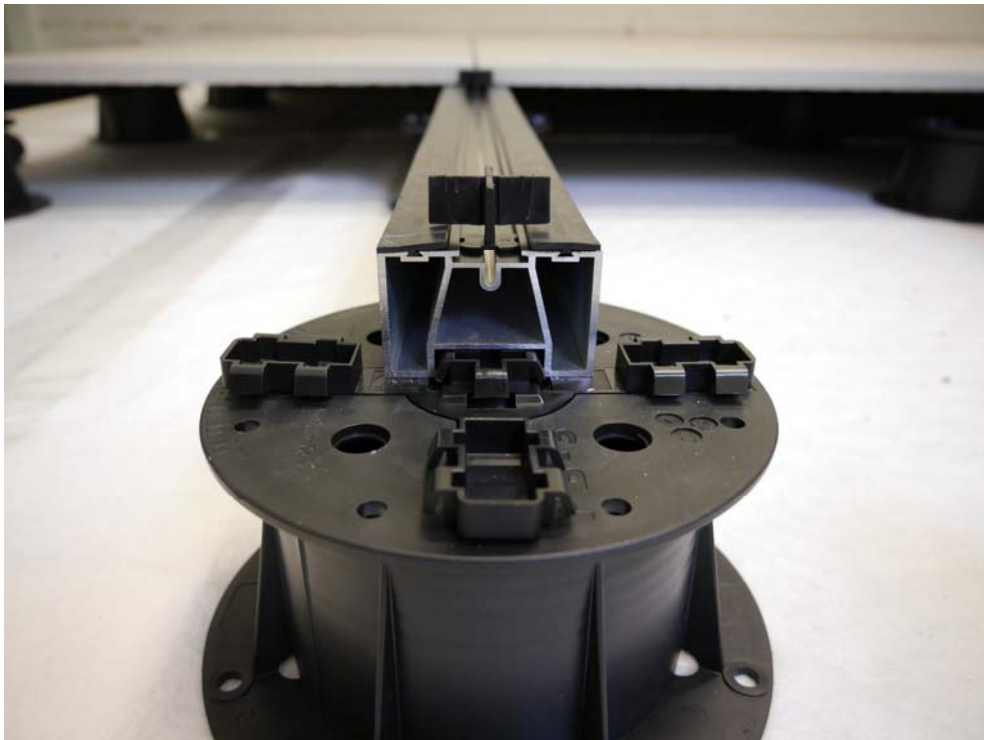


Figure B.2. Pedestal Buzon PB-3 with Kit 2 and support profile.

Ceramic tiles on support profiles and pedestals



Figure B.3. Test setup during mounting: support profiles on pedestals and impact sound insulation layer.

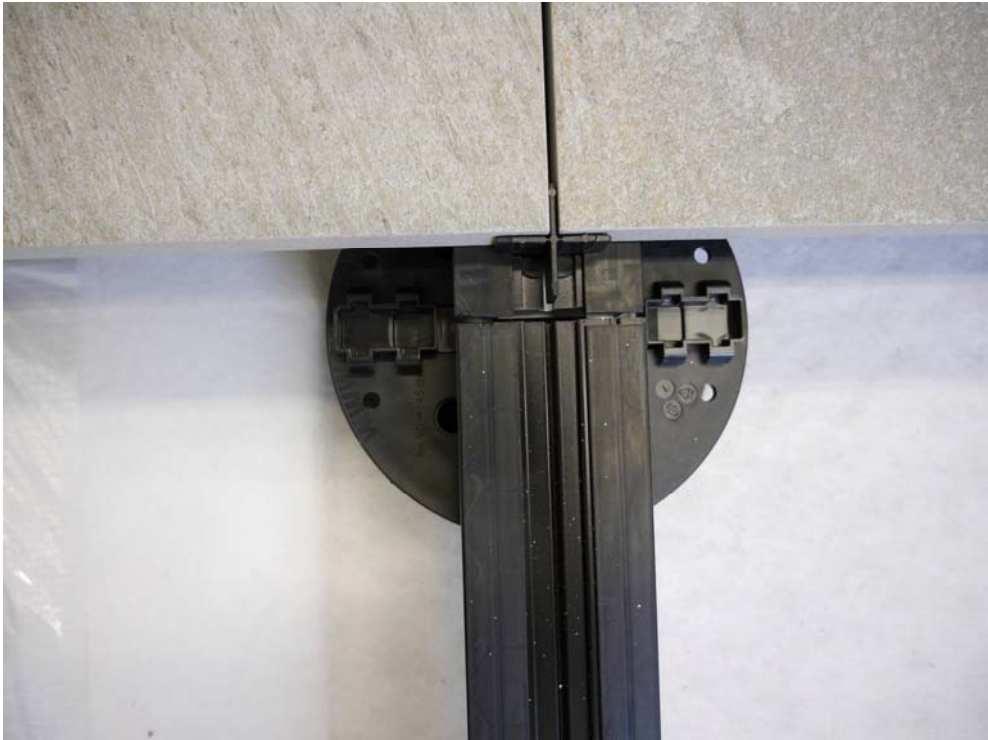


Figure B.4. Test setup during mounting: pedestals with support profiles and partly laid ceramic tiles.

S:\MIP\Proj\133M\133001\M133001_06_PBE_1E.DOCX : 13. 06. 2018

Ceramic tiles on support profiles and pedestals



Figure B.5. Test setup in the ceiling test facility: ready for testing.

Ceramic tiles on support profiles and pedestals

(Manufacturer drawings: schematic designs, dimensions in mm)

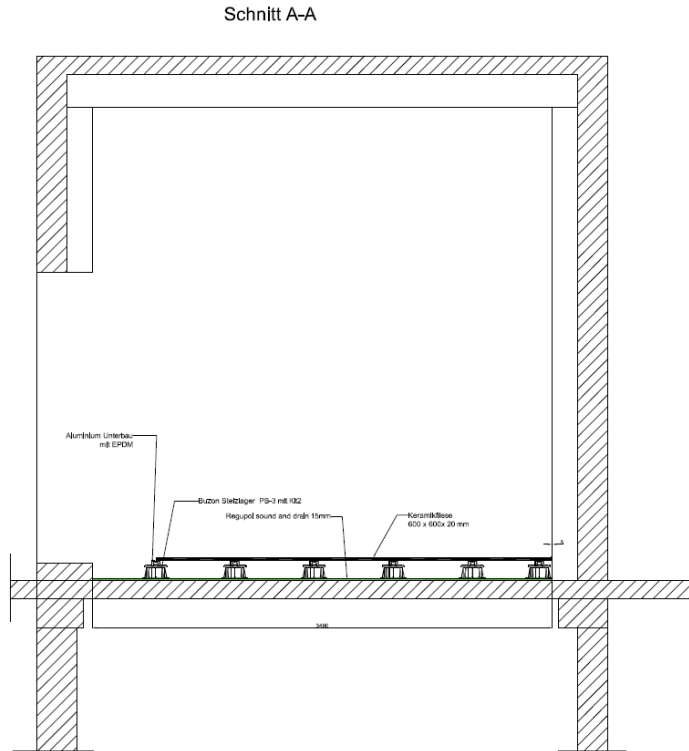


Figure C.1. Test setup in the ceiling test facility: cross section.

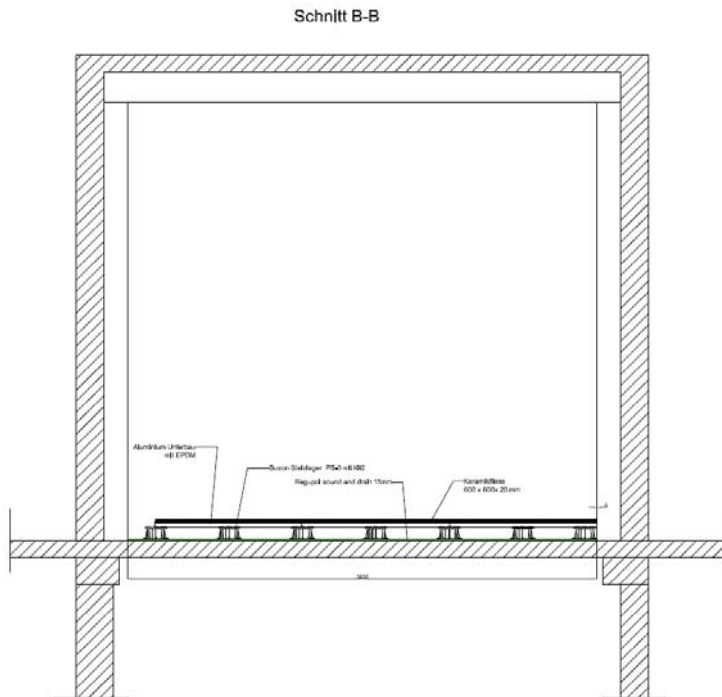


Figure C.2. Test setup in the ceiling test facility: longitudinal section.

Ceramic tiles on support profiles and pedestals

(Manufacturer drawings: schematic designs, dimensions in mm)

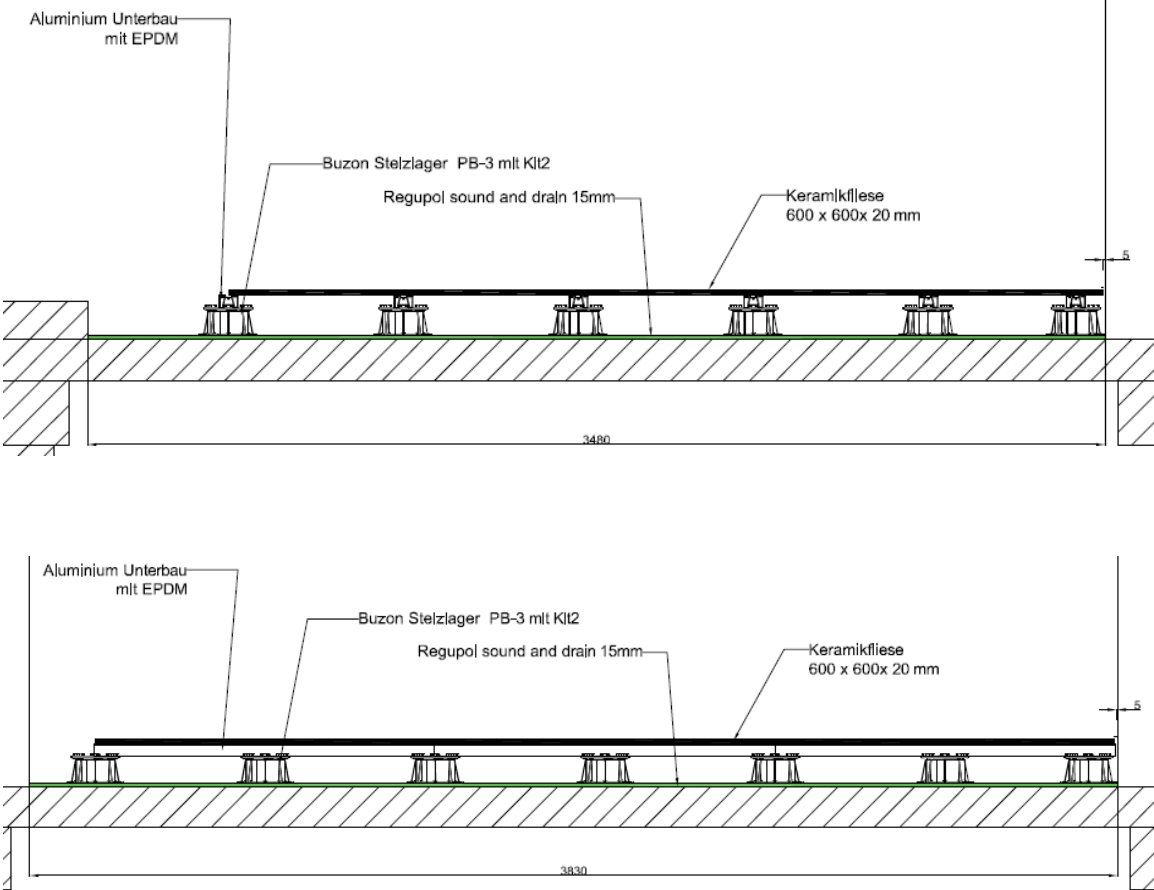


Figure C.3. Test setup in the ceiling test facility: structure details, cross section and longitudinal section.

S:\IMP\Proj\133M\133001\M133001_06_PBE_1E.DOCX : 13. 06. 2018

Description of the test procedure for the determination of the improvement of impact sound insulation of a floor covering

1 Measurands

The improvement of the impact sound insulation ΔL of a floor covering on a heavy-weight reference floor was determined according the following equation:

$$\Delta L = L_{n,0} - L_n$$

With:

$L_{n,0}$ normalized impact sound pressure level of the heavyweight reference floor without floor covering

L_n normalized impact sound pressure level of the heavyweight reference floor with the floor covering

The normalized impact sound pressure levels L_n resp. $L_{n,0}$ are determined as follows:

$$L_n = L_i + 10 \log(A/A_0) \text{ dB}$$

With:

L_i average sound pressure level in a one-third octave band in the receiving room, when the tested floor covering is excited by the standard tapping machine (impact sound pressure level) in dB

A equivalent sound absorption area in the receiving room in m^2

A_0 reference absorption area $A_0 = 10 \text{ m}^2$

Information concerning the repeatability and comparability of the test method are given in EN ISO 12999 [1].

For the single-number value ΔL_w a standard uncertainty of 1.1 dB is indicated in EN ISO 12999 [1], Table 7. This value corresponds to the standard uncertainty of reproducibility determined in round-robin tests and describes the standard uncertainty of test results obtained in a test stand for a constructional element under reproducibility conditions. Taking into consideration a coverage factor $k = 1.00$, an expanded uncertainty of $U = 1.1 \text{ dB}$ results for the 2 sided test (confidence level 68 %).

2 Test procedure

2.1 Description of the test facility

The ceiling test facility meets the requirements according section 4 of EN ISO 10140-5 [6].

The heavyweight concrete reference floor was homogenous and had a uniform thickness of 140 mm. The dimensions of the reference floor in the source room were length x width = 3.83 m x 3.48 m = 13.33 m^2 .

In order to increase the diffusivity of the sound field and to adjust the reverberation time, seven plate resonators and three porous absorbers were placed on the walls of the receiving room. In order to reduce the airborne sound pressure level in the source room, two absorber boxes (dimensioned length x width x height = 0.6 m x 0.6 m x 1.3 m) were arranged on the floor.

Figures D.1 and D.2 show drawings of the test facility.

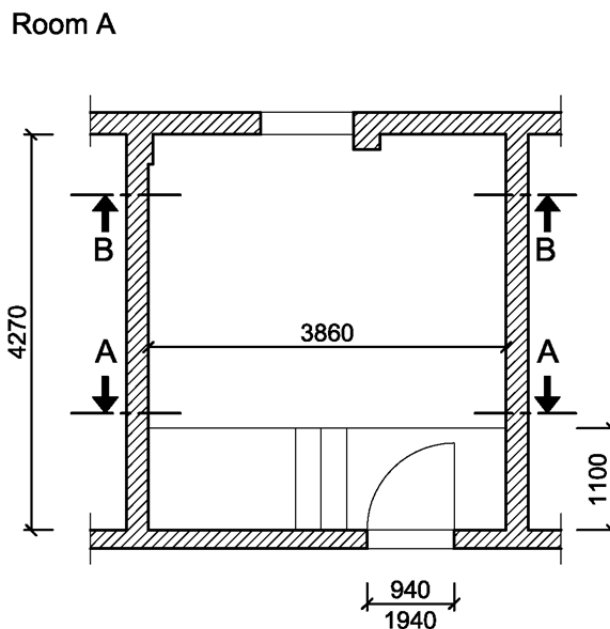
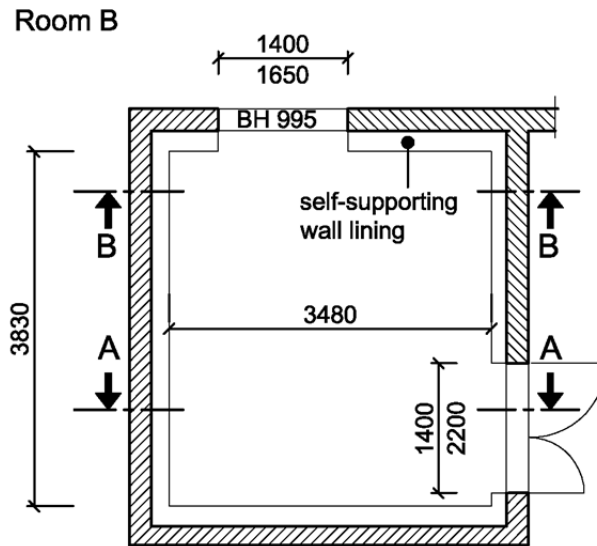


Figure D.1. Floor plans of the source and receiving rooms of the ceiling test facility (dimensions in mm).

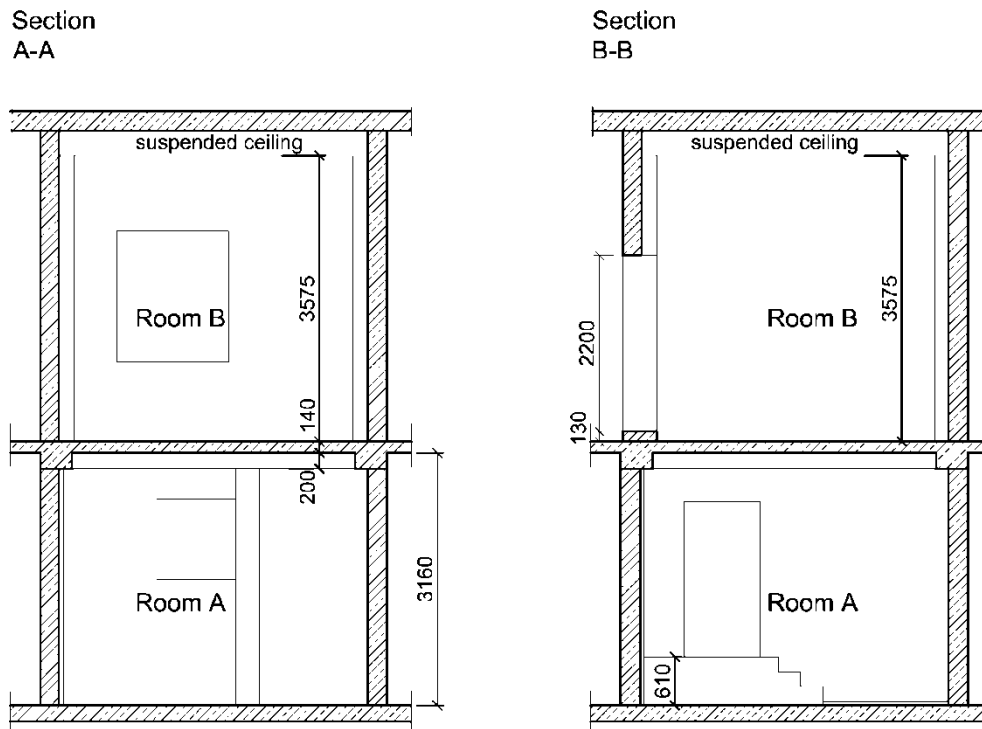


Figure D.2. Sections of the ceiling test facility (dimensions in mm).

2.2 Determination of the impact sound pressure level

The impact sound was generated by a standard tapping machine.

The measurement of the averaged sound pressure level was executed by continuously moved microphones in both the source and the receiving room. The sweep radius of the microphones was 1.0 m. The plane of the traverse of the microphones was inclined by approx. 10° to the horizontal. The microphone traverses were distributed equally in the permitted room volume.

The standard tapping machine was placed at an angle of 45° to the anisotropic floor construction at five different positions, distributed irregularly on the tested floor of the source room. The distance between the standard tapping machine and the edges of the floor was at least 0.5 m.

The rms-averages of the sound pressure level at the different microphone positions and positions of the standard tapping machine, each in the source and the receiving room, were determined.

The following minimum distances of the microphone positions were considered:

- 0.7 m between each microphone position and room boundaries
- 1.0 m between each microphone position and test specimen

Measurement of the sound pressure level was effected in one-third octave bands.

A dependence of the impact sound pressure level on the time of excitation by the standard tapping machine could not be determined.

2.3 Determination of the airborne sound pressure level difference

A pink noise signal was used as a test sound. The sound pressure level difference between adjacent one-third octave bands in the source room was < 6 dB.

A dodecahedron was used in terms of sound source. The excitation was effected at two loudspeaker positions in the source room. The sound source was arranged in such a way that the sound field generated was as diffuse as possible. For this purpose, the excitation was effected in the upper corner positions. The distance between the sound source positions and the floor was at least 2 m, so that the part of the direct sound of the sound source onto the test specimen was negligible compared to the diffuse sound.

The measurement of the averaged sound pressure level was executed by continuously moved microphones in both the source and the receiving room. The sweep radius of the microphones was 1.0 m. The plane of the traverse of the microphones was inclined by approx. 10° to the horizontal. The microphone traverses were equally distributed in the permitted room volume.

For each of the two sound source positions two microphone traverses were registered. The averaging time of 60 seconds corresponded to the duration of two traverses of the moved microphones.

After correction of background noise for all sound source positions, the rms-average of the sound pressure at the different microphone positions were determined, each in the source and the receiving room. The sound pressure level difference D_i of a sound source position was determined from the rms-averaged sound pressure levels. The sound pressure level difference D is calculated as follows:

$$D = -10 \log \left(\frac{1}{n} \sum_{i=1}^n 10^{-0,1D_i} \right) \text{ dB}$$

The following minimum distances of the microphone positions were considered:

- 0.7 m between each microphone position and room boundaries
- 1.0 m between each microphone position and sound source
- 1.0 m between each microphone position and test object

Measurement of the sound pressure level was effected in one-third octave bands.

The measurement results were determined for one measuring direction.

2.4 Correction of the airborne noise transmission in the determination of the impact sound pressure level

For the determination of the influence of the sound power level radiated into the source room by the standard tapping machine and the structures excited by it, on the impact sound level in the receiving room, the corrected impact sound pressure level was calculated according to DIN 4109-11 [8] as follows:

$$L = 10 \log(10^{0.1 L_E} - 10^{0.1(L_{HW}-D)}) \text{ dB}$$

With:

- L corrected impact sound pressure level in dB
- L_E impact sound pressure level in the receiving room (including the disturbing impact sound level) in dB
- L_{HW} sound pressure level in the source room during operation of the standard tapping machine in dB
- D sound pressure level difference between source and receiving room according to section 2.3 in dB

According to EN ISO 10140-3 [4], the airborne sound part transmitted from the source room to the receiving room must be by at least 10 dB lower than the level of the transmitted impact sound pressure level. If this condition could not be complied with, a level correction ΔL of the impact sound level L_E was carried out for the determination of the corrected impact sound level L , whereby the level correction was limited to maximum $\Delta L_{\max} = 1.3$ dB, i. e. $L \geq L_E - \Delta L_{\max}$ dB.

The results corrected due to indirect paths of airborne noise transmission are marked in the test certificate as follows:

- $\Delta L \geq \Delta L_{\max}$: "minimum value determined by indirect path of transmission"
- $0.5 \text{ dB} < \Delta L < \Delta L_{\max}$: "corrected value with indirect path of transmission"
- other: no marking

2.5 Correction for background noise

In case the averaged sound pressure level in the receiving room during excitation with the standard tapping machine was less than 15 dB higher than the average sound pressure level of the background noise, the averaged sound pressure level in the receiving room was corrected according to the following equation:

$$L = 10 \log(10^{0.1 L_{sb}} - 10^{0.1 L_b}) \text{ dB}$$

With:

L corrected sound pressure level in the receiving room in dB

L_{sb} sound pressure level in the receiving room
(including background noise level) in dB

L_b sound pressure level of background noise in the receiving room in dB

The level correction ΔL of the sound pressure level in the receiving room L_{sb} for calculation of the corrected sound pressure level in the receiving room L was limited to a maximum of $\Delta L_{max} = 1.3$ dB, i. e. $L \geq L_{sb} - \Delta L_{max}$ dB according to EN ISO 10140-4 [5]

The test results which are corrected due to the background noise are indicated in the test certificates as follows:

- $\Delta L \geq \Delta L_{max}$: "minimum value determined by background noise"
- $0,14 \text{ dB} < \Delta L < \Delta L_{max}$: "corrected value with background noise"
- other: no marking

2.6 Determination of the equivalent sound absorption area

The equivalent sound absorption area was calculated on the basis of the reverberation time measured according to EN ISO 3382-2 [10] using the Sabine's formula:

$$A = 0.16 \times V/T \text{ m}^2$$

With:

A equivalent sound absorption area in m^2

V volume of the receiving room in m^3

T reverberation time in the receiving room in s

For the determination of the reverberation time the interrupted noise method was used. After excitation of the receiving room using a Pink-Noise signal as test signal, the decay curve was registered. A dodecahedron was used as sound source. In order to produce a steady-state sound pressure level in the receiving room, the excitation time was fixed to 2 s. The differences of resulting sound pressure levels of adjacent one-third octave bands in the source room was less than 6 dB.

The determination of the reverberation time was performed for each single decay curve. The evaluation of decay curves was made by linear averaging. The evaluation of the reverberation time was carried out beginning 5 dB below the initial sound pressure level. The evaluation range comprised 20 dB. The level difference between the sound pressure level during excitation with the sound source and the level of the background noise was in each one-third octave band at least 35 dB. For each loudspeaker-microphone-combination two decay curves were determined and the reverberation times averaged arithmetically. In total, the reverberation time was determined for two loudspeaker positions at three fixed microphone positions. The reverberation times averaged of two decay curves of each of the six microphone-loudspeaker-combinations were also averaged arithmetically.

2.7 List of test equipment

For the measurements and evaluations the test equipment indicated in the list below was used:

Table D.1. Test equipment.

Designation	Manufacturer	Type	Serial-No.	Calibration valid until
Building acoustics measurement system, test facility	Norsonic	121	26341	2017-12
Amplifier	APart	Champ One	10050104	
Dodecahedron	Müller-BBM	DOD360A	372832	2018-08
Dodecahedron	Müller-BBM	DOD360A	372833	2018-08
Dodecahedron	Müller-BBM	DOD250B	324709	2019-06
Dodecahedron	Müller-BBM	DOD250B	324710	2019-06
Microphone swivel facility	Norsonic	212	12986	
Microphone swivel facility	Norsonic	212	12991	
Pre-amplifier microphone with free-field microphone	Norsonic Norsonic	1201 1220	26145 25160	2017-12
Pre-amplifier microphone with free-field microphone	Norsonic Norsonic	1201 1220	30588 26071	2017-12
Pistonphone	Brüel & Kjaer	4228	1651956	2018-12
Standard tapping machine	Norsonic	211	12961	2019-08
Software for measurement and evaluation	Müller-BBM	Bau4	Version 1.10	