

## TEST REPORT

for

**Regupol America  
33 Keystone Drive  
Lebanon, PA 17042  
Bill Devin/ 717-675-2198**

### **Impact Sound Transmission Test**

ASTM E 492 – 09 / ASTM E 989 – 06

On

**8 Inch (203mm) Concrete Slab Overlaid with  
Engineered Hardwood Flooring Adhered with Sikabond-T35 Adhesive over  
Regupol Sonus HS1000, 10 mm Underlayment Adhered with Sikabond-T35  
Adhesive With Suspended Gypsum Board Ceiling**

Report Number: NGC 7011101\_R2


Assignment Number: G-709

Test Date: 08/22/2011


Report Approval Date: 09/13/2011

Reissue Date: 8/20/2014

Submitted by: \_\_\_\_\_

  
Andrew E. Heuer  
Senior Test Engineer

Reviewed by: \_\_\_\_\_

  
Robert J. Menchetti  
Director

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

**Revision Summary:**

<b>Date</b>	<b>SUMMARY</b>
Approval Date: 9/13/2011	Original issue date. Original NGCTS report #: NGC 7011101
Reissue Date: 6/24/2014	Reissued Report #: NGC 7011101_R1 The report was reissued due to a client designated company name change.
Reissue Date: 8/20/2014	Reissue Report #: NGC 70110101_R2 The report was revised and reissued due to a client designate product name change and company name change.

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

Report Number: NGC 7011101\_R2

Page 3 of 5

**Test Method:** This test method is in accordance with American Society for Testing and Materials Standard Test Method for Laboratory Measurement of Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine - Designation: E 492-09 / E 989-06.  
The uncertainty limits of each tapping machine location met the precision requirements of section A1.4 of ASTM E 492-09.

**Specimen Description:** 8 inch (203mm) Concrete Slab including suspended grid 5/8 inch gypsum board ceiling system, overlaid with, according to client, Engineered wood flooring with Sikabond-T35 adhesive over Regupol Sonus HS1000, 10 mm underlayment adhered with Sikabond-T35 adhesive.

The test specimen was a floor-ceiling assembly consisting of the following:

- 1 layer of 13.1mm (0.515 in.) Hard Maple Select V Engineered Hardwood flooring. Samples were 127mm (5 in.) wide, by random length planks. Sample weight was 7.5 kg/m<sup>2</sup> (1.54 PSF).
- 1 layer of Sikabond-T35 adhesive. Sample was troweled on using client supplied P5 trowel.
- 1 layer of, according to client, Regupol Sonus HS1000, 10 mm underlayment. The underlayment was adhesively applied to the concrete with Sikabond-T35 adhesive. Measured thickness: 10.0 mm (0.395 in.) Measured weight: 7.7 kg/m<sup>2</sup> (1.58 PSF)
- 1 layer of Sikabond-T35 adhesive. Sample was troweled on using client supplied P5 trowel.
- 203.2mm (8 in.) thick reinforced concrete slab 488.2 kg/m<sup>2</sup> (100.0 PSF).
- 88.9mm (3-1/2 in.) fiberglass unfaced batt insulation. Sample weight was 0.78 kg/m<sup>2</sup> (0.16 PSF). The insulation was laid over the suspended grid system parallel with the main tee's.
- Gypsum board ceiling suspension system. System is comprised of main tees and cross tees. The main tees were placed 1219.2mm (48 in.) on center and the cross tees were placed 609.6mm (24 in.) on center. 16 gauge galvanized tie wire was used to attach the main tees to concrete anchors, located 1219.2mm (48 in.) o.c. along the longitudinal axis, suspending the grid 304.8mm (12 in.) below the concrete slab.
- 1 layer of 15.9mm (5/8 in.) Type X gypsum board. Sample was observed to be 15.9mm (0.628 in.) thick and weighed 11.2 kg/m<sup>2</sup> (2.3 PSF). The board was attached 304.8mm (12 in.) o.c. parallel to suspended grid suspension system mains, using 31.8mm (1.250 in.) Type S drywall screws. The board joints were taped.

The overall weight of the test assembly is 515.44 kg/m<sup>2</sup> (105.58 PSF).

The perimeter of the concrete slab was sealed with a rubber gasket and a sand filled trough. The test frame is structurally isolated from the receiving room.

**Test Floor Size:** 3657.6mm x 4876.8mm (12 ft. x 16 ft.)

**Conditioning:** Concrete cured minimum of 28 days. Adhesive cured for minimum of 24 hours.

**Test Results:** The results of the tests are given on pages 4 and 5.

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

<b>Normalized impact sound pressure level</b>						
Test: ASTM E 492 - 09 / ASTM E 989 - 06						
Test Report: NGC 7011101_R2					Date: 8/24/2011	
Specimen Size [m <sup>2</sup> ]: 17.8					Page 4 of 5	
<b>Source room</b>			<b>Receiving room</b>			
Rm Temp [°C]: 24.5			Volume [m <sup>3</sup> ]: 60			
Humidity [%]: 52			Rm Temp [°C]: 22.5			
			Humidity [%]: 49			
<b>Impact Insulation Class IIC [dB]:</b>			<b>74</b>			
Sum of Unfavorable Deviations [dB]:			28			
Max. Unfavorable Deviation [dB]:			8 at 100 Hz			
Frequency	L <sub>n</sub>	L2	d	Corr.	u.Dev.	ΔL <sub>n</sub>
[Hz]	[dB]	[dB]	[dB/s]	[dB]	[dB]	
100	46	49.3	32.2	-3.3	8	1.82
125	43	48.1	21.8	-5.1	5	2.05
160	43	48.4	18.1	-5.4	5	1.27
200	42	47.2	16.9	-5.2	4	0.53
250	37	42.6	18.2	-5.6		0.90
315	40	44.9	18.4	-4.9	2	0.38
400	39	45.7	18.0	-6.7	2	0.42
500	38	44.3	19.0	-6.3	2	0.27
630	34	40.8	20.7	-6.8		0.36
800	26	32.1	21.2	-6.1		0.24
1000	27	31.4	22.9	-4.4		0.10
1250	24	27.5	25.1	-3.5		0.25
1600	13	18.7	26.4	-5.7		0.33
2000	12	17.4	30.3	-5.4		0.18
2500	10	14.2	33.9	-4.2		0.16
3150	9	13.6	36.1	-4.6		0.10
4000	10	13.7	40.8	-3.7		0.13
5000	7	10.8	46.3	-3.8		0.12
<p>L<sub>n</sub> = Normalized Sound Pressure Level, dB                      L2 = Receiving Room Level, dB                      d = Decay Time, dB/second                      ΔL<sub>n</sub> = Uncertainty for 95% Confidence Level</p>						

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

**Normalized impact sound pressure level**

Test: ASTM E 492 - 09 / ASTM E 989 - 06

Page 5 of 5


Test Report: NGC 7011101\_R2

Test Date: 8/24/2011

Specimen Size [m<sup>2</sup>]: 17.8

**Impact Insulation Class IIC [dB]: 74**

Frequency [Hz]	L <sub>n</sub> [dB]
100	46
125	43
160	43
200	42
250	37
315	40
400	39
500	38
630	34
800	26
1000	27
1250	24
1600	13
2000	12
2500	10
3150	9
4000	10
5000	7

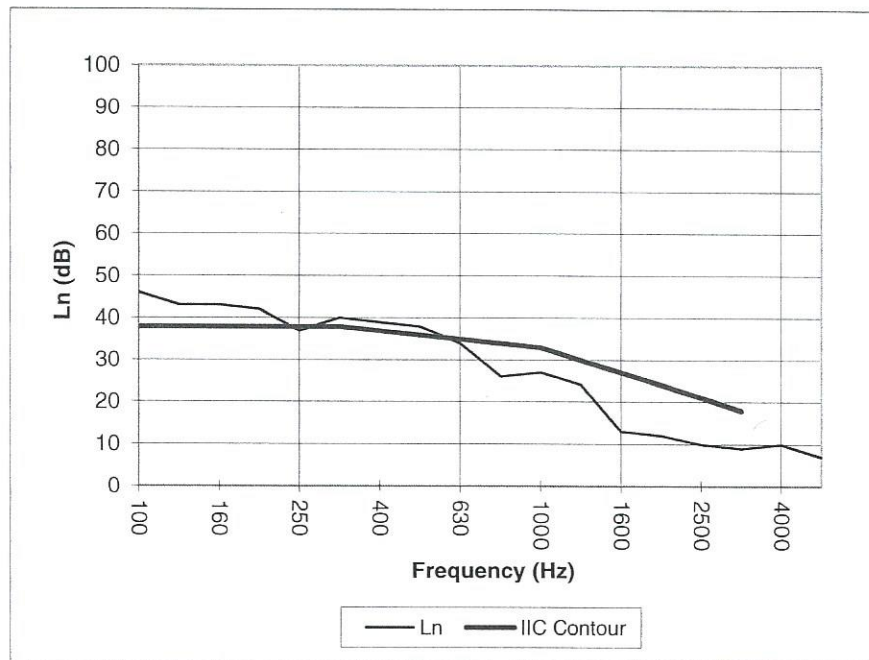

\* Due to high insulating value of specimen, background levels limit results at these frequencies.

L<sub>n</sub> = Normalized Sound Pressure Level, dB

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.